


Technical Manual

R454B 208/230V 1Ph 60Hz

14.3 SEER2 REGULAR SPLITS SYSTEM

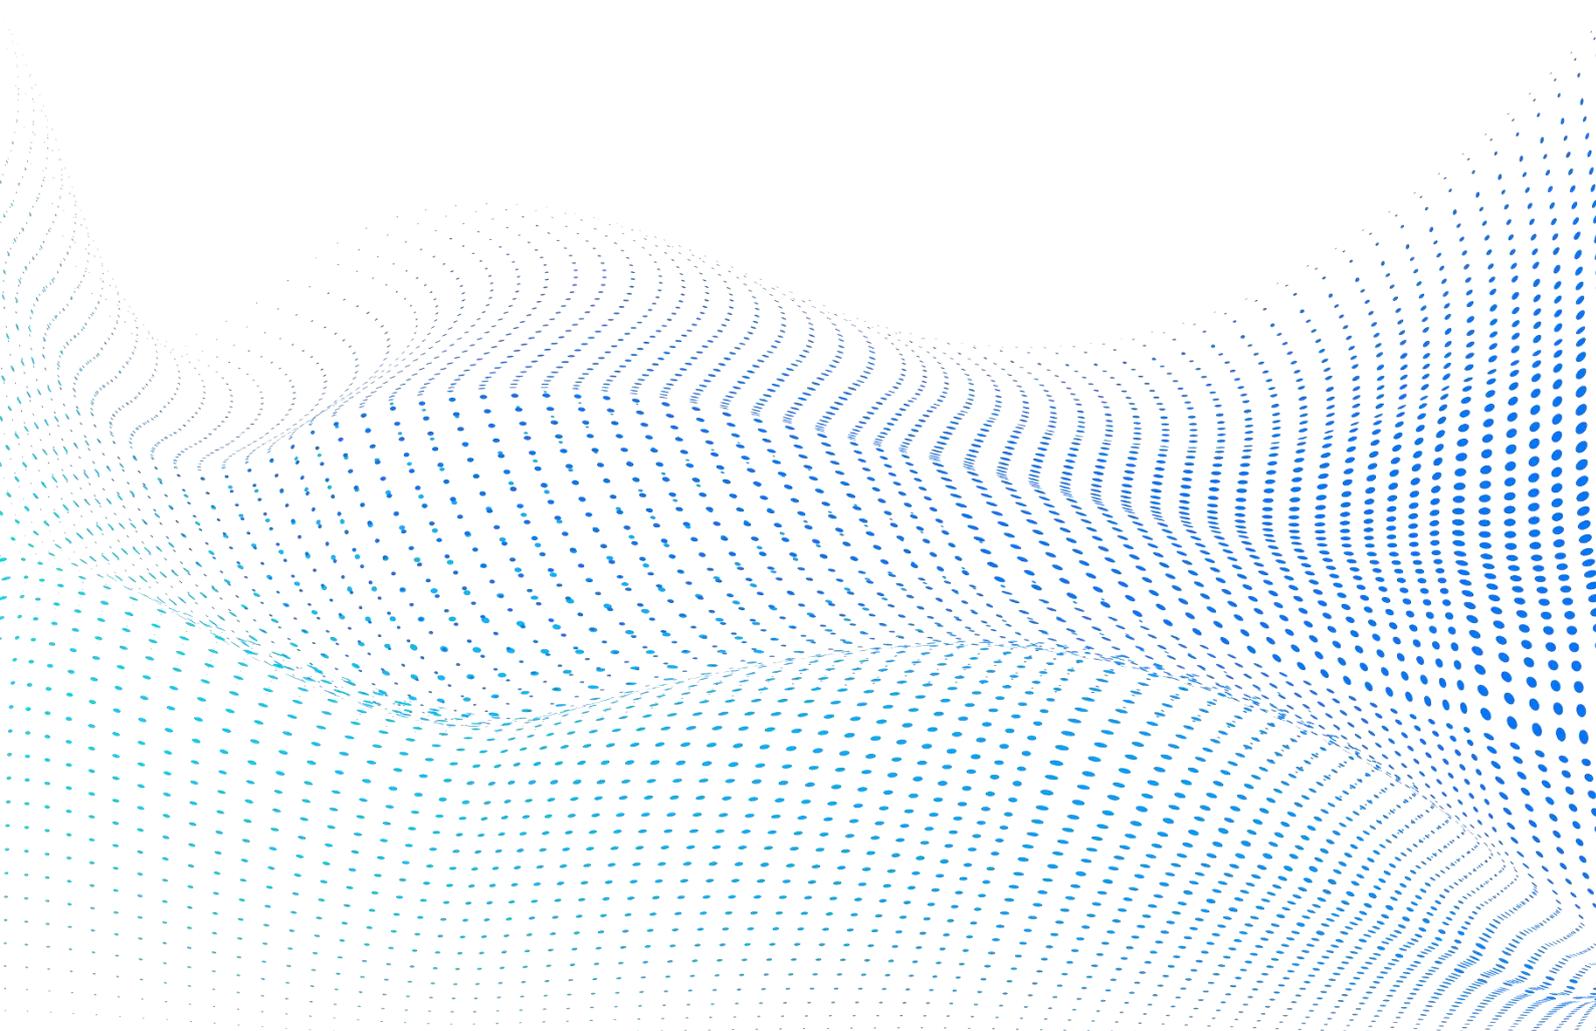

Content

Part 1. General Information3

 1. Model Names of Indoor/Outdoor Units..... 4

 2. External Appearance..... 5

 3. Features..... 6

Part 2. Indoor Unit.....8

 1.Specification..... 9

 2.Dimension 10

 3.Service Space 11

 4.Four-way installation 12

 5.Air Filter (Not Factory Installed) 14

 6.Electric heater 15

 7.Airflow performance 16

 8.Wiring Diagrams..... 18

 9.Electric Characteristics..... 18

 10.The Specification of Wiring 19

 11.Field Wiring 20

 12.Exploded View 23

Part 3 Outdoor Unit.....24

 1.Specification..... 25

 2.Dimensions 33

 3.Service Space 34

 4.Wiring Diagrams..... 35

 5.Electric Characteristics..... 36

 6.Operation Limits..... 36

 7.Sound Levels 36

 8.Exploded View 37

 9.Troubleshooting 39

Part 4 Function introduction53

 1.Electrical Components Description 54

 2.Indoor Coil Anti-Freezing Function 54

 3.Outdoor gas return temperature Anti-Freezing Function 55

 4.R454B Leakage Detection Function..... 55

 5.Defrost Description..... 55

Part 5 Installation57

 1.Precaution on Installation..... 58

 2.Oil return bend installation 60

 3.Vacuum Dry and Leakage Checking 61

 4.Additional Refrigerant Charge 63

 5.Insulation Work 65

 6.Test Operation..... 67

Part 1. General Information

1. Model Names of Indoor/Outdoor Units.....	4
2. External Appearance.....	5
3. Features.....	6

1. Model Names of Indoor/Outdoor Units

1.1 Indoor Units

Model name	Dimension(W×H×D) (inch)	Power supply
CP143S18HPAH	19-5/8×45-3/4×22	208/230V-1Ph-60Hz
CP143S24HPAH	19-5/8×45-3/4×22	208/230V-1Ph-60Hz
CP143S30HPAH	19-5/8×45-3/4×22	208/230V-1Ph-60Hz
CP143S36HPAH	19-5/8×45-3/4×22	208/230V-1Ph-60Hz
CP143S42HPAH	22×53-1/8×24-1/2	208/230V-1Ph-60Hz
CP143S48HPAH	22×53-1/8×24-1/2	208/230V-1Ph-60Hz
CP143S60HPAH	22×53-1/8×24-1/2	208/230V-1Ph-60Hz

1.2 Outdoor Units

Model name	Dimension(W×H×D) (inch)	Power supply
CP143S18HPCO	21-4/5×25×21-4/5	208/230V-1Ph-60Hz
CP143S24HPCO	21-4/5×25×21-4/5	208/230V-1Ph-60Hz
CP143S30HPCO	29-1/7×25×29-1/7	208/230V-1Ph-60Hz
CP143S36HPCO	29-1/7×25×29-1/7	208/230V-1Ph-60Hz
CP143S42HPCO	29-1/7×32-7/8×29-1/7	208/230V-1Ph-60Hz
CP143S48HPCO	29-1/7×32-7/8×29-1/7	208/230V-1Ph-60Hz
CP143S60HPCO	29-1/7×32-7/8×29-1/7	208/230V-1Ph-60Hz
CP143S18SCCO	21-4/5×25×21-4/5	208/230V-1Ph-60Hz
CP143S24SCCO	21-4/5×25×21-4/5	208/230V-1Ph-60Hz
CP143S30SCCO	29-1/7×25×29-1/7	208/230V-1Ph-60Hz
CP143S36SCCO	29-1/7×25×29-1/7	208/230V-1Ph-60Hz
CP143S42SCCO	29-1/7×32-7/8×29-1/7	208/230V-1Ph-60Hz
CP143S48SCCO	29-1/7×32-7/8×29-1/7	208/230V-1Ph-60Hz
CP143S60SCCO	29-1/7×32-7/8×29-1/7	208/230V-1Ph-60Hz

2. External Appearance

		14.3 SEER2 TDU		
capacity	1.5/2 Ton	2.5/3 Ton	3.5/4/5 Ton	
pic				
14.3 SEER2 AHU				
capacity	1.5/2/2.5/3 Ton		3.5/4/5 Ton	
pic				

3. Features

3.1 Wide operation range. Heating:5-80°F. Cooling:54-118°F. High vertical / Long line heat pump mode14~80°F

3.2 Well-known brand LG scroll compressor, reliable quality.

3.3 Condenser coils constructed with copper tubing and enhanced golden fins.

3.4 Use PISTON as expansion device

3.5 DC fan motors, provide selections of air flow to meet desired applications.

3.6 ECM fan motor for air handlers, higher efficiency, lower noise, constant speed.

3.7 24V control, time delay relay, fan relay and transformer included.

3.8 R454b environment friendly refrigerant.

3.9 The air handler unit has a refrigerant leakage sensor, providing safer protection.

3.10 AHRI certification, ETL certification.

3.11 Multiple defrosting modes are available.





3.12 Refrigerant leakage sensor is configured to detect the refrigerant content in the air

Intelligent oil return program to provide operating life

“A” shape coils, constructed with Oxygen-free copper tubing and enhanced aluminum fins

Detachable air filter for cleaning or renewal

Versatile 4-way convertible design. The air can be discharged from four directions.

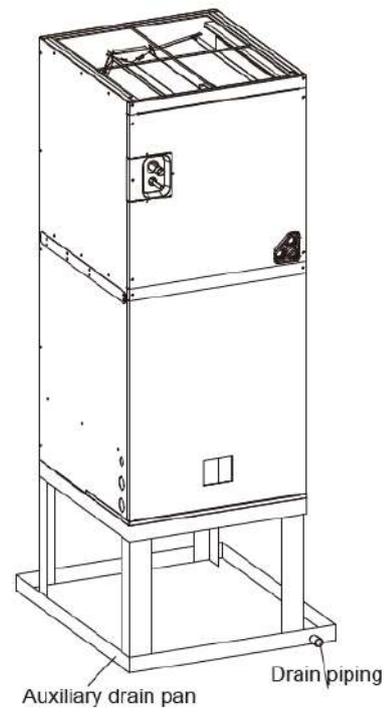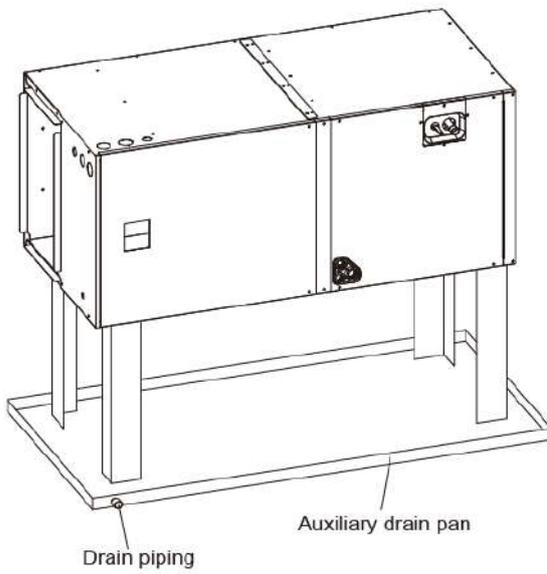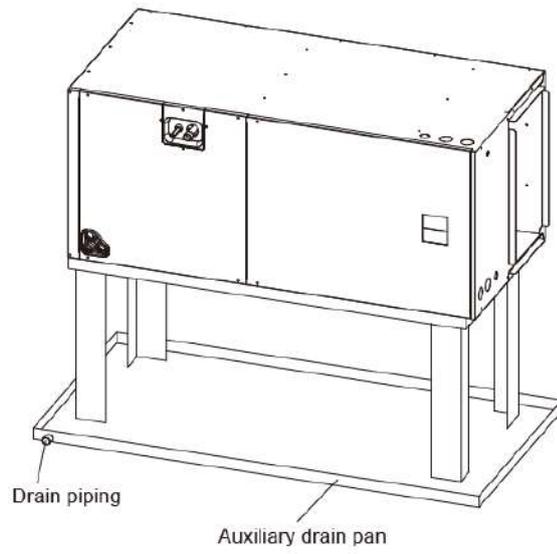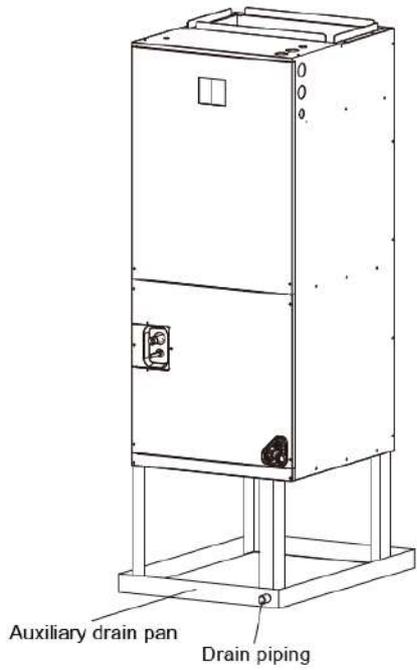

Part 2. Indoor Unit

1.Specification.....	9
2.Dimension.....	10
3.Service Space.....	11
4.Four-way installation.....	12
5.Air Filter (Not Factory Installed).....	14
6.Electric heater.....	15
7.Airflow performance.....	16
8.Wiring Diagrams.....	18
9.Electric Characteristics.....	18
10.The Specification of Wiring.....	19
11.Field Wiring.....	20
12.Exploded View.....	23

1.Specification

Market Model		cooling only							
Power supply	V/Ph/Hz	CP143S18HPAH 208~230V/1N/60Hz	CP143S24HPAH 208~230V/1N/60Hz	CP143S30HPAH 208~230V/1N/60Hz	CP143S36HPAH 208~230V/1N/60Hz	CP143S42HPAH 208~230V/1N/60Hz	CP143S48HPAH 208~230V/1N/60Hz	CP143S60HPAH 208~230V/1N/60Hz	
Indoor external static pressure	Pa	145	145	145	145	145	145	145	
Throttle type		piston							
MCA	A	4	4	5	5	7	7	7	
MOP	A	6	6	6	6	10	10	10	
Indoor coil	Number of row	3(row)×2(piece)	3(row)×2(piece)	4(row)×2(piece)	4(row)×2(piece)	4(row)×2(piece)	5(row)×2(piece)	5(row)×2(piece)	
	Tube pitch(a)×row pitch(b)	in 0.83×0.53	0.83×0.53	0.83×0.53	0.83×0.53	0.83×0.53	0.83×0.53	0.83×0.53	
	Fin spacing	in 1/16	1/16	1/16	1/16	1/16	1/16	1/16	
	Fin material	Hydrophilic							
	Tube outside diameter	in Φ 0.276	Φ 0.276	Φ 0.276	Φ 0.276	Φ 0.276	Φ 0.276	Φ 0.276	
	Tube material	inner grooved							
	Coil length x height x width	in 17 5/8×14 7/8×1 5/8	17 5/8×14 7/8×1 5/8	16 1/2×17 1/2×2 1/8	16 1/2×17 1/2×2 1/8	17 7/16×16 17/32×2 7/64	19 27/32×21 1/2×2 5/8	19 27/32×21 1/2×2 5/8	
	Number of circuit	6	6	8	8	/	/	/	
Indoor fan motor	Brand	Broad-Ocean							
	Type	ECM							
	Model	DZJ-249F-12	DZJ-249F-12	DZJ-373F-12	DZJ-373F-12	DZJ-560F-12	DZJ-560F-12	DZJ-560F-12	
	Rate current	A 2.6	2.6	3.8	3.8	5.4	5.4	5.4	
	Input	W 142.4	142.4	245.9	245.9	249.3	249.3	249.3	
	Output	W 249	249	373	373	560	560	560	
	Capacitor	μF /	/	/	/	/	/	/	
	Speed (Hi/Me Hi/Me/Me lo/Lo) 5/4/3/2/1	RPM 643/593/556/476/412	643/593/556/476/412	760/718/662/610/548	760/718/662/610/548	977/833/760/683/610	977/833/760/683/610	977/833/760/683/610	
Blower	diameter	in 12 5/16	12 5/16	12 5/16	12 5/16	12 5/16	12 5/16	12 5/16	
	width	in 12 29/32	12 29/32	12 29/32	12 29/32	12 29/32	12 29/32	12 29/32	
Indoor air flow	CFM	770	785	975	1030	1330	1490	1700	
Indoor noise level	dB(A)	50	54	56	56	59	59	60	
Indoor dimension	Unit (WxHxD)	in	19-5/8×45-3/4×22	19-5/8×45-3/4×22	19-5/8×45-3/4×22	19-5/8×45-3/4×22	22×53-1/8×24-1/2	22×53-1/8×24-1/2	22×53-1/8×24-1/2
		mm	500×1162×560	500×1162×560	500×1162×560	500×1162×560	560×1350×623	560×1350×623	560×1350×623
	Packing (WxHxD)	in	22-5/6×47-5/8×25-3/5	22-5/6×47-5/8×25-3/5	22-5/6×47-5/8×25-3/5	22-5/6×47-5/8×25-3/5	28×54-3/4×25-1/5	28×54-3/4×25-1/5	28×54-3/4×25-1/5
		mm	580×1210×650	580×1210×650	580×1210×650	580×1210×650	710×1390×640	710×1390×640	710×1390×640
	Net / Gross weight	kg	56/61.5	56/61.5	60/63.5	60/63.5	72/78	72/78	77/83
lbs		123/135	123/135	132/140	132/140	159/172	159/172	170/183	
Shipping per STD 20/40/40HQ		30/60/120	30/60/120	30/60/120	30/60/120	30/60/120	27/54/54	27/54/54	

Notes:

- Nominal cooling capacities are based on the following conditions:
Indoor temp: 27°C DB, 19°C CWB; Outdoor temp: 35°C DB; Equivalent ref. piping: 5m (horizontal)
- Actual noise level may differ, depending on the room structure, etc., since these noise values are from an anechoic room.

2.Dimension


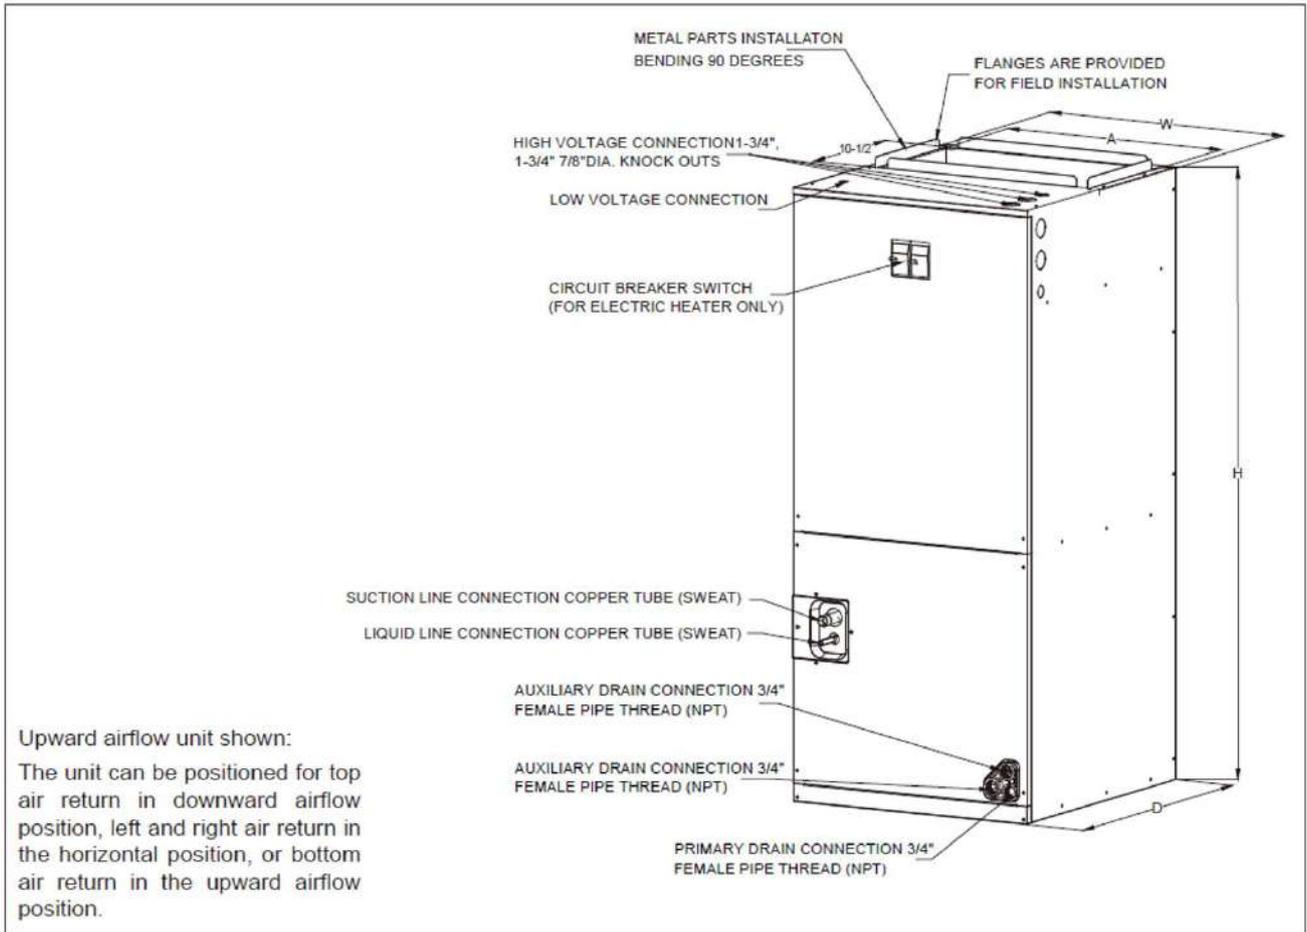


Fig.1 DIMENSIONS
 DIMENSIONAL DATA

MODEL SIZE	Dimensions				
	UNIT HEIGHT "H"/in (mm)	UNIT WIDTH "W"/in (mm)	UNIT LENGTH "D"/in (mm)	SUPPLY DUCT "A"/in (mm)	LIQUID LINE / VAPOR LINE IN (mm)
	45-3/4 [1162]	19-5/8 [500]	22 [560]	17-7/8 [454]	3/8 / 3/4 [9.5]/[19]
24K	45-3/4 [1162]	19-5/8 [500]	22 [560]	17-7/8 [454]	3/8 / 3/4 [9.5]/[19]
	45-3/4 [1162]	19-5/8 [500]	22 [560]	17-7/8 [454]	3/8 / 3/4 [9.5]/[19]
36K	45-3/4 [1162]	19-5/8 [500]	22 [560]	17-7/8 [454]	3/8 / 3/4 [9.5]/[19]
	53-1/8 [1350]	22 [560]	24 -1/2[623]	19-1/2 [496]	3/8 / 7/8 [9.5]/[22]
48K	53-1/8 [1350]	22 [560]	24 -1/2[623]	19-1/2 [496]	3/8 / 7/8 [9.5]/[22]
60K	53-1/8 [1350]	22 [560]	24 -1/2[623]	19-1/2 [496]	3/8 / 7/8 [9.5]/[22]

3. Service Space

The distance between the air outlet or return air and the wall must be at least 40 inches, and the front of the indoor unit must be at least 25 inches away from the wall.

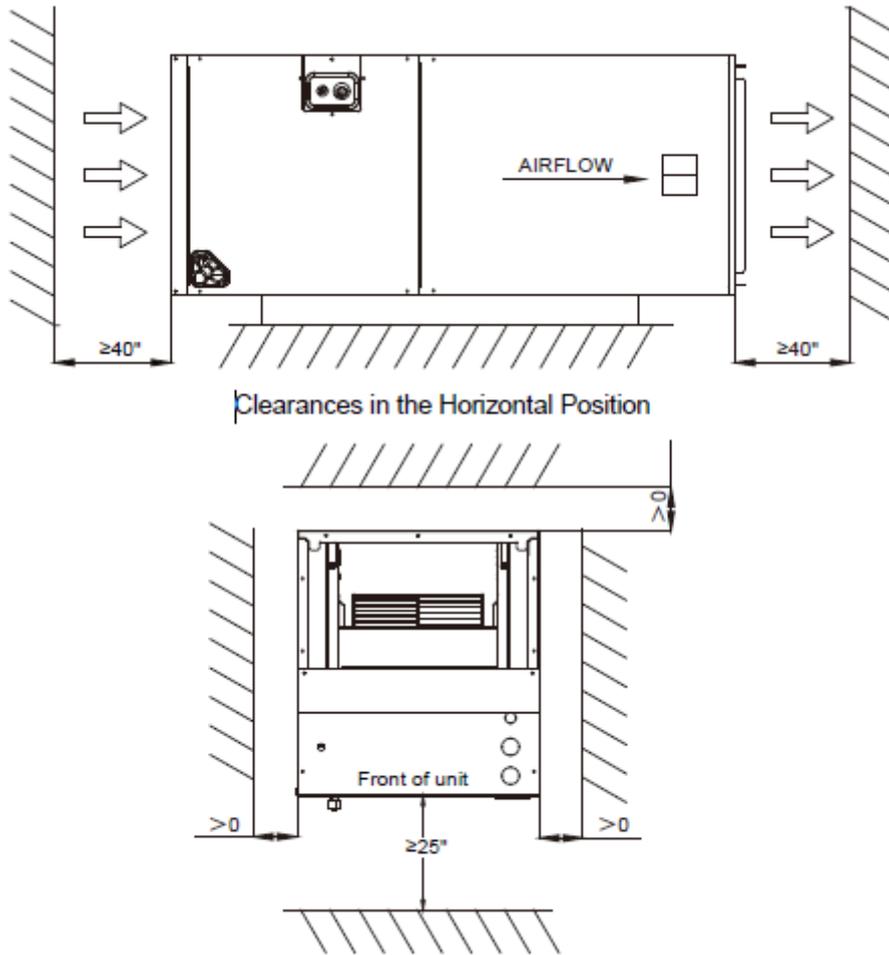

4. Four-way installation

Horizontal right installation is the default factory configuration for all models. By removing the indoor coil assembly and reinstalling the coil, the vertical up flow position can be converted into a horizontal left position. Rotate the device by 90° to the horizontal left position, with the coil segment on the right and the blower segment on the left. Re-install the indoor coil by rotating 180° from the original position. Ensure that the fixing groove is fully engaged with the coil guide rail. When configured to be placed horizontally above the ceiling and/or living space, it is recommended to use an additional field supplied drain pan.

Steps to Change Cabinet Direction to Vertical Downward or Horizontal Left Direction

1. Remove the screws and the front panel, and disconnect the plug of T1 sensor 、 T2 sensor and leak detection sensor wire from the circuit board (Figure 4.1, Step 1).
2. Pull out the coil with sensor wire (do not disconnect T1 sensor、 T2 sensor and leak detection sensor from the coil). (Figure 4.2, Step 2)
3. Install the coil in the correct direction and fix it in place. Reinsert those sensor wire in PCBA through the gap on the cabinet cover (Figure 4.3, Step 3).

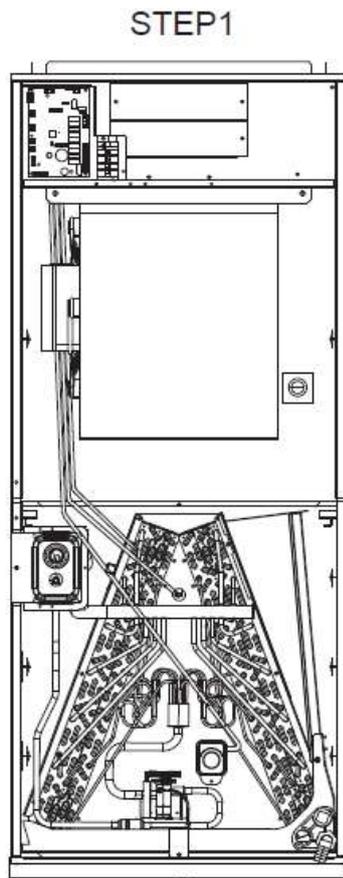


Figure 4.1

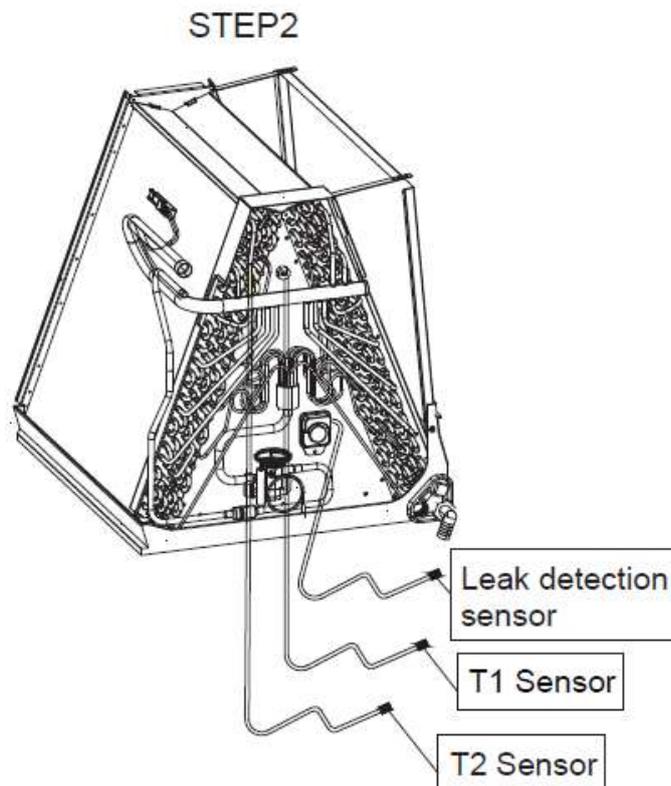


Figure 4.2

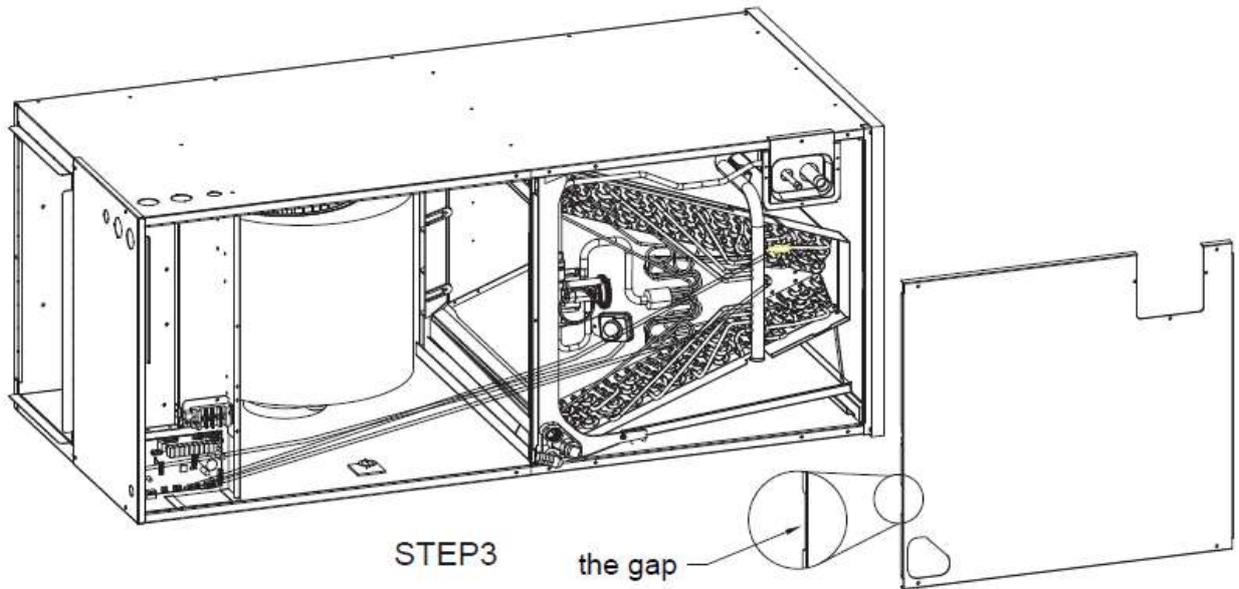


Figure 4.3

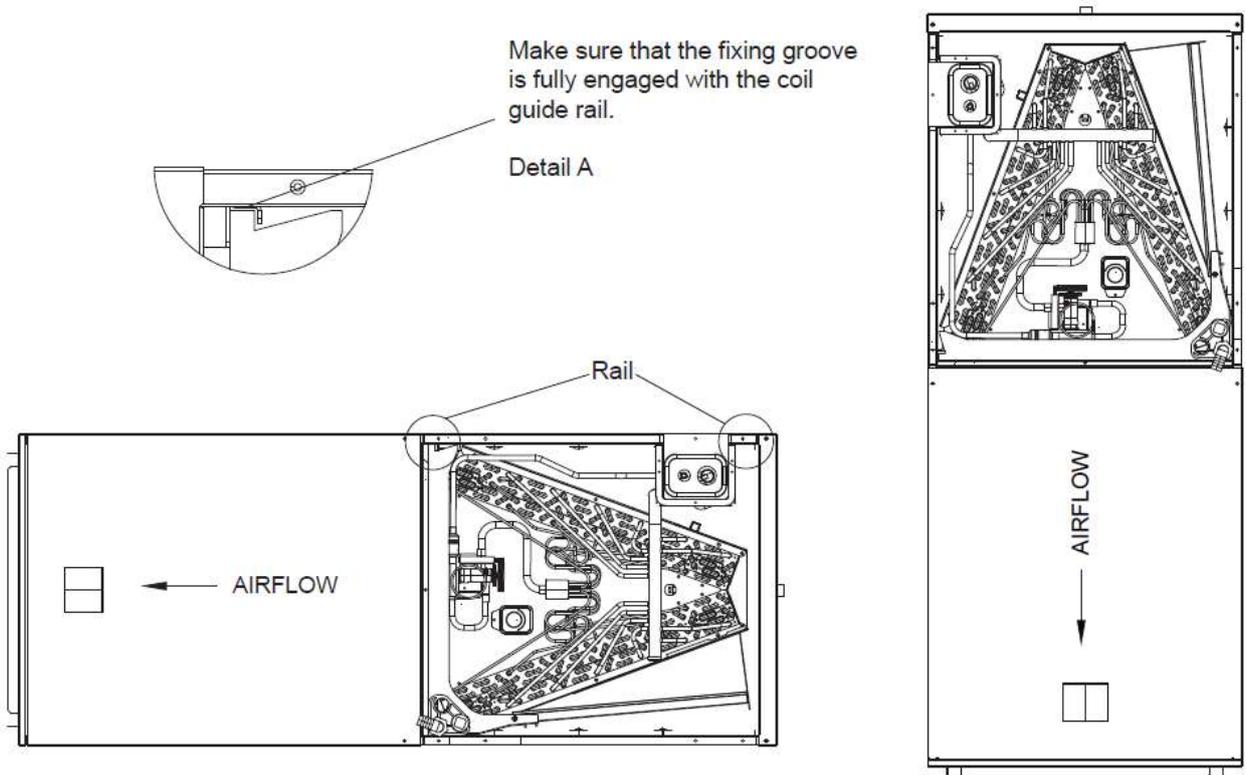


Figure 4.3


5. Air Filter (Not Factory Installed)

The filter is not included in the device and must be provided on site.

The size of external filters or other filtering devices must meet the maximum flow rate of 300ft/min or meet the recommended value of filter type.

The application and placement of filter is very important for airflow, which may affect the performance of heating and cooling system. Reduced airflow will shorten the life of the main components of the system, such as motors, components, thermal relays, evaporator coils or compressors. Therefore, we recommend that the return air duct system has only one filter position. For systems without return air filter grids, multiple filter grids can be installed at each return air opening.

If a high-efficiency filter screen or electronic air filtration system is used, it is very important that the air flow rate is not reduced. If the air flow decreases, the overall performance and efficiency of the device will decrease. It is strongly recommended to contact professional installation technicians to ensure the correct installation of such filtration systems.

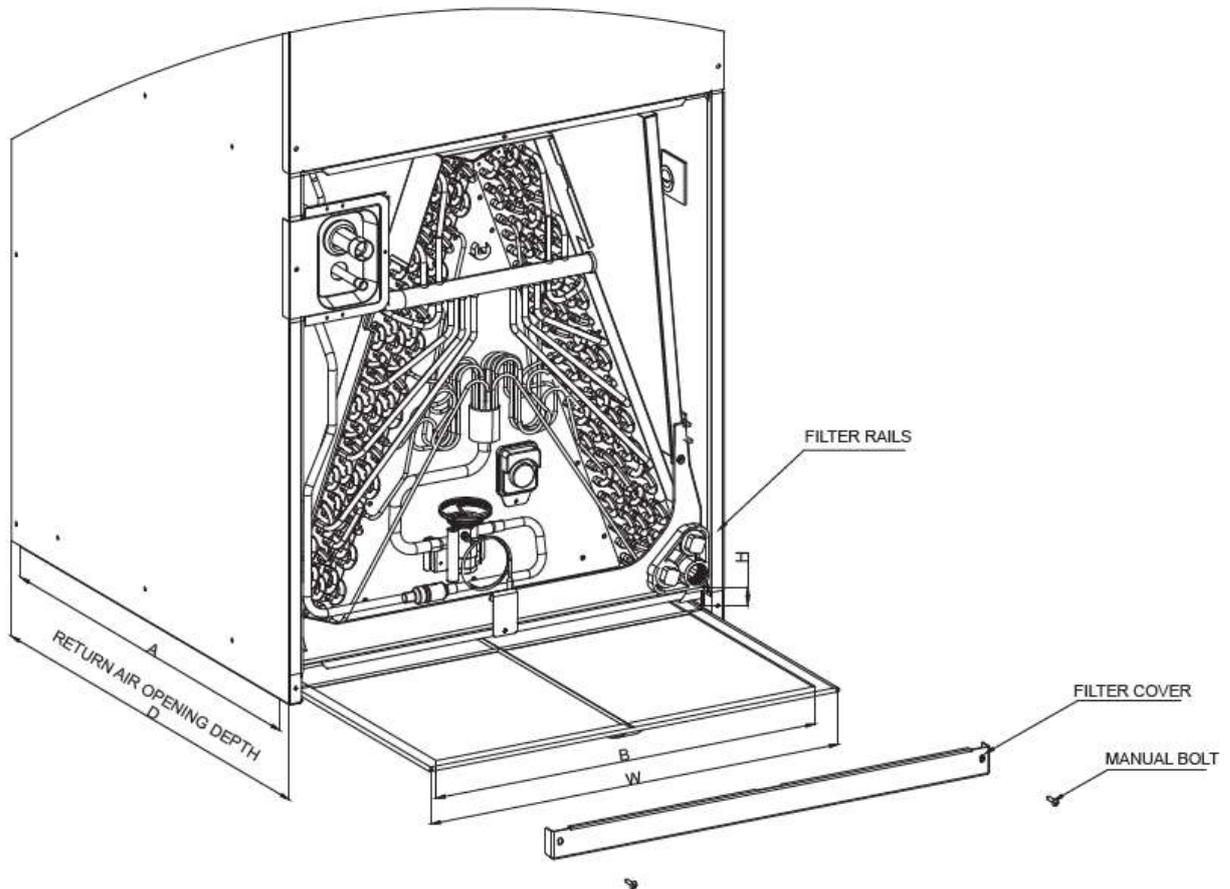

Model	Filter size inches [mm]	"W" Inch [mm]	"D" Inch [mm]	"H" Inch [mm]	Return Width "A" inch [mm]	Return Length "B" inch [mm]
18K/24K/30K/36K	18.1×21.4[460×544]	18.3 [466]	21.6 [548]	1 [25.4]	20.8 [528]	16.3 [414]
42K/48K/60K	20.5×23.8[521×605]	20.7 [526]	23.9 [608]	1 [25.4]	23 [584]	18.8 [478]

6. Electric heater

Heat kit model	AHU model	electric heat (kW)	MIN. Circuit Ampacity		MAX. Fuse or Breaker Ampacity		Fan speed				
			208 VAC	230 VAC	208 VAC	230 VAC	1	2	3	4	5
21-4444-01	18K	5	20	25	30	35	●	●	●	●	●
21-4444-02		7.5	30	35	40	45	×	×	●	●	●
21-4444-01	24K	5	20	25	30	35	●	●	●	●	●
21-4444-02		7.5	30	35	40	45	×	×	●	●	●
21-4444-03		10	40	45	55	60	×	×	×	●	●
21-4444-01	30K	5	20	25	30	35	●	●	●	●	●
21-4444-02		7.5	30	35	40	45	×	●	●	●	●
21-4444-03		10	40	45	55	60	×	×	●	●	●
21-4444-01	36K	5	20	25	30	35	●	●	●	●	●
21-4444-02		7.5	30	35	40	45	×	●	●	●	●
21-4444-03		10	40	45	55	60	×	×	●	●	●
21-4444-04		15	30+30	35+35	40+40	45+45	×	×	×	●	●
21-4444-01	42K	5	20	25	30	35	●	●	●	●	●
21-4444-02		7.5	30	35	40	45	●	●	●	●	●
21-4444-03		10	40	45	55	60	×	●	●	●	●
21-4444-04		15	30+30	35+35	40+40	45+45	×	×	●	●	●
21-4444-01	48K	5	20	25	30	35	●	●	●	●	●
21-4444-02		7.5	30	35	40	45	●	●	●	●	●
21-4444-03		10	40	45	55	60	×	●	●	●	●
21-4444-04		15	30+30	35+35	40+40	45+45	×	×	●	●	●
21-4444-05		20	40+40	45+45	55+55	60+60	×	×	×	●	●
21-4444-01	60K	5	20	25	30	35	●	●	●	●	●
21-4444-02		7.5	30	35	40	45	●	●	●	●	●
21-4444-03		10	40	45	55	60	×	●	●	●	●
21-4444-04		15	30+30	35+35	40+40	45+45	×	×	●	●	●
21-4444-05		20	40+40	45+45	55+55	60+60	×	×	×	●	●

● indicates availability, and × indicates unavailability

7. Airflow performance

The air flow data is based on the cooling performance of coil and without filter. Performance table, select the appropriate product.

External static pressure ESP should be kept within the minimum and maximum limits shown in the following table to ensure the normal operation of cooling, heating, and electric heating.


Model size of air processor	Motor speed		SCFM								
			External Static Pressure-Inch Water Column [kPa]								
			0[0]	0.1[.025]	0.2[.050]	0.3[.075]	0.4[.100]	0.5[.125]	0.6[.150]	0.7[.175]	0.8[.200]
18K	Tap (1)	SCFM	669.9	571.8	490.9	394.3	269.5	-	-	-	-
		Watts	41	47	52	57	61	-	-	-	-
	Tap (2)	SCFM	792.2	708.6	615.9	548.5	474.2	371.5	265.1	-	-
		Watts	59	67	73	77	83	88	93	-	-
	Tap (3)	SCFM	948.8	887.5	809.6	723.6	671.6	597.0	504.2	410.2	-
		Watts	96	102	109	115	129	126	132	141	-
	Tap (4)	SCFM	1020.9	966.5	887.1	798.4	738.8	697.9	672.3	572.8	490.1
		Watts	118	127	136	144	150	156	160	167	177
	Tap (5)	SCFM	1115.2	1059.2	995.0	906.5	842.5	791.4	727.2	707.0	652.5
		Watts	148	157	167	178	186	191	198	205	211
24K	Tap (1)	SCFM	669.9	571.8	490.9	394.3	269.5	-	-	-	-
		Watts	41	47	52	57	61	-	-	-	-
	Tap (2)	SCFM	792.2	708.6	615.9	548.5	474.2	371.5	265.1	-	-
		Watts	59	67	73	77	83	88	93	-	-
	Tap (3)	SCFM	948.8	887.5	809.6	723.6	671.6	597.0	504.2	410.2	-
		Watts	96	102	109	115	129	126	132	141	-
	Tap (4)	SCFM	1020.9	966.5	887.1	798.4	738.8	697.9	672.3	572.8	490.1
		Watts	118	127	136	144	150	156	160	167	177
	Tap (5)	SCFM	1115.2	1059.2	995.0	906.5	842.5	791.4	727.2	707.0	652.5
		Watts	148	157	167	178	186	191	198	205	211
30K	Tap (1)	SCFM	955.3	897.8	839.5	739.4	655.3	575.9	511.5	432.4	392.2
		Watts	91	96	102	110	115	121	127	138	140
	Tap (2)	SCFM	1080.7	1031.5	977.4	925.6	819.4	743.8	675.5	608.7	547.1
		Watts	125	131	137	143	153	160	166	173	179
	Tap (3)	SCFM	1182.2	1138.1	1089.0	1042.9	986.9	879.5	811.4	749.5	689.2
		Watts	158	165	172	177	185	197	203	212	221
	Tap (4)	SCFM	1305.6	1261.8	1220.9	1179.5	1132.2	1086.1	984.1	914.5	856.6
		Watts	207	214	221	228	236	244	257	266	273
	Tap (5)	SCFM	1386.7	1350.0	1309.4	1274.6	1233.1	1186.6	1137.8	1031.5	970.0
		Watts	245	253	262	270	277	285	295	309	318
36K	Tap (1)	SCFM	955.3	897.8	839.5	739.4	655.3	575.9	511.5	432.4	392.2
		Watts	91	96	102	110	115	121	127	138	140
	Tap (2)	SCFM	1080.7	1031.5	977.4	925.6	819.4	743.8	675.5	608.7	547.1
		Watts	125	131	137	143	153	160	166	173	179
	Tap (3)	SCFM	1182.2	1138.1	1089.0	1042.9	986.9	879.5	811.4	749.5	689.2
		Watts	158	165	172	177	185	197	203	212	221
	Tap (4)	SCFM	1305.6	1261.8	1220.9	1179.5	1132.2	1086.1	984.1	914.5	856.6
		Watts	207	214	221	228	236	244	257	266	273
	Tap (5)	SCFM	1386.7	1350.0	1309.4	1274.6	1233.1	1186.6	1137.8	1031.5	970.0
		Watts	245	253	262	270	277	285	295	309	318

15SEER REGULAR SPLITS SYSTEM TECHNICAL MANUAL

42K	Tap (1)	SCFM	1343.9	1271.9	1208.5	1150.9	1085.5	1042.0	899.4	839.6	777.6
		Watts	141.9	150.5	159.2	168	175	185	196	202	210
	Tap (2)	SCFM	1513.9	1451.5	1392.2	1320.2	1266.8	1211.4	1148.5	1036.2	975.4
		Watts	194.2	203.9	214	220.2	228.8	238.7	247.9	264.2	271.9
	Tap (3)	SCFM	1672.5	1620.5	1562.0	1522.0	1470.6	1422.7	1371.1	1309.8	1204.8
		Watts	259	271	282	293	303	312	323	333	353
	Tap (4)	SCFM	1807.3	1781.4	1731.6	1686.0	1640.4	1595.5	1547.1	1509.5	1460.8
		Watts	328.4	343.6	357.5	370.6	385.6	395.2	407	418	430
	Tap (5)	SCFM	2048.0	2000.5	1950.9	1905.3	1861.4	1819.2	1776.4	1729.9	1684.1
		Watts	447	462	476	491	507	520	525.6	538	550
48K	Tap (1)	SCFM	1343.9	1271.9	1208.5	1150.9	1085.5	1042.0	899.4	839.6	777.6
		Watts	141.9	150.5	159.2	168	175	185	196	202	210
	Tap (2)	SCFM	1513.9	1451.5	1392.2	1320.2	1266.8	1211.4	1148.5	1036.2	975.4
		Watts	194.2	203.9	214	220.2	228.8	238.7	247.9	264.2	271.9
	Tap (3)	SCFM	1672.5	1620.5	1562.0	1522.0	1470.6	1422.7	1371.1	1309.8	1204.8
		Watts	259	271	282	293	303	312	323	333	353
	Tap (4)	SCFM	1807.3	1781.4	1731.6	1686.0	1640.4	1595.5	1547.1	1509.5	1460.8
		Watts	328.4	343.6	357.5	370.6	385.6	395.2	407	418	430
	Tap (5)	SCFM	2048.0	2000.5	1950.9	1905.3	1861.4	1819.2	1776.4	1729.9	1684.1
		Watts	447	462	476	491	507	520	525.6	538	550
60K	Tap (1)	SCFM	1275.4	1220.3	1165.5	1115.8	1051.6	974.7	913.6	859.1	800.6
		Watts	153	163	173	183	194	203	212	220	231
	Tap (2)	SCFM	1435.1	1381.7	1335.1	1289.5	1243.6	1186.2	1113.6	1075.9	1016.2
		Watts	210	220	232	243	254	266	276	287	297
	Tap (3)	SCFM	1610.6	1567.1	1528.1	1482.2	1440.8	1396.1	1350.6	1261.8	1219.6
		Watts	287	301	313	325	336	355	361	381	391
	Tap (4)	SCFM	1756.8	1718.5	1674.5	1633.8	1601.1	1557.2	1519.5	1475.1	1426.2
		Watts	366	376	392	405	415	431	444	459	472
	Tap (5)	SCFM	1917.1	1882.9	1842.6	1798.9	1772.9	1734.2	1700.6	1662.9	1622.4
		Watts	467	482	496	512	525	542	553	569	584

The highlighted area indicates the airflow within the required range of 300-450cfm/ton.

8.Wiring Diagrams

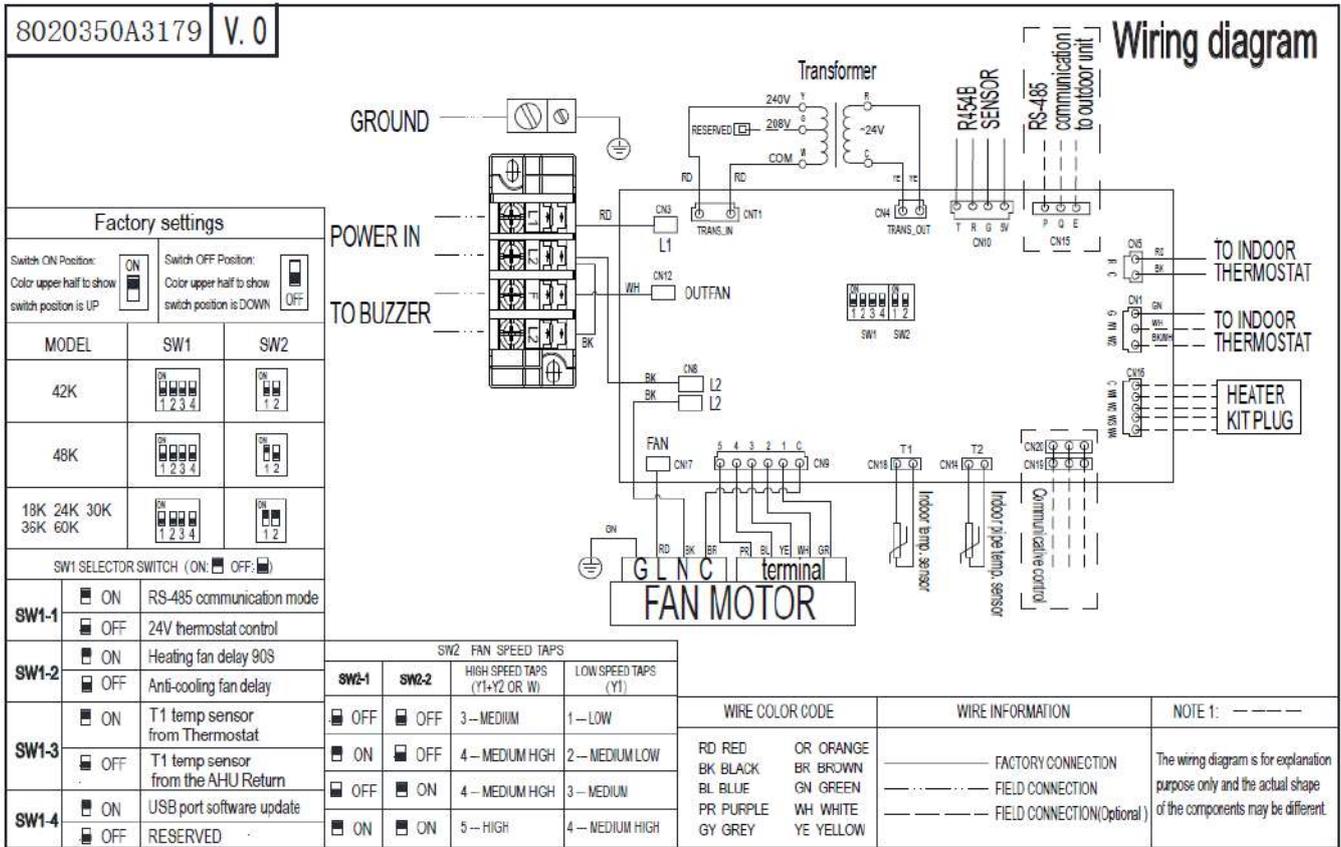

9.Electric Characteristics

Model	Indoor Units					
	Hz	Voltage	Min.	Max.	MCA	MOP
18K	60	208-230V	187V	253V	4.0	6.0
24K	60	208-230V	187V	253V	4.0	6.0
30K	60	208-230V	187V	253V	5.0	6.0
36K	60	208-230V	187V	253V	4.0	6.0
42K	60	208-230V	187V	253V	7.0	10.0
48K	60	208-230V	187V	253V	7.0	10.0
60K	60	208-230V	187V	253V	7.0	10.0

10.The Specification of Wiring

Note:


The cross-section areas of wires or lines should not be less than the corresponding ones listed in the table below; Besides, if the power wires is quite long from the unit, please choose the windings with larger cross-section guarantee the normal power supply.

Model	Indoor power wire /Diameter (AWG)	24V Signal wire Diameter (AWG)	Outdoor power wire /Diameter (AWG)
18K	3*16	18	3*14
24K	3*16	18	3*14
30K	3*16	18	3*12
36K	3*16	18	3*12
42K	3*16	18	3*10
48K	3*16	18	3*10
60K	3*16	18	3*10

11. Field Wiring




1. To avoid the electrical shock, please connect the air conditioner with the ground lug.
2. The main power plug in the air conditioner has been joined with the ground wiring, please don't change it freely.
3. The power socket is used as the air conditioner specially.
4. Don't pull the power wiring hard.
5. When connecting the air conditioner with the ground, observe the local codes.
6. If necessary, use the power fuse or the circuit, breaker or the corresponding scale ampere.


power supply wiring

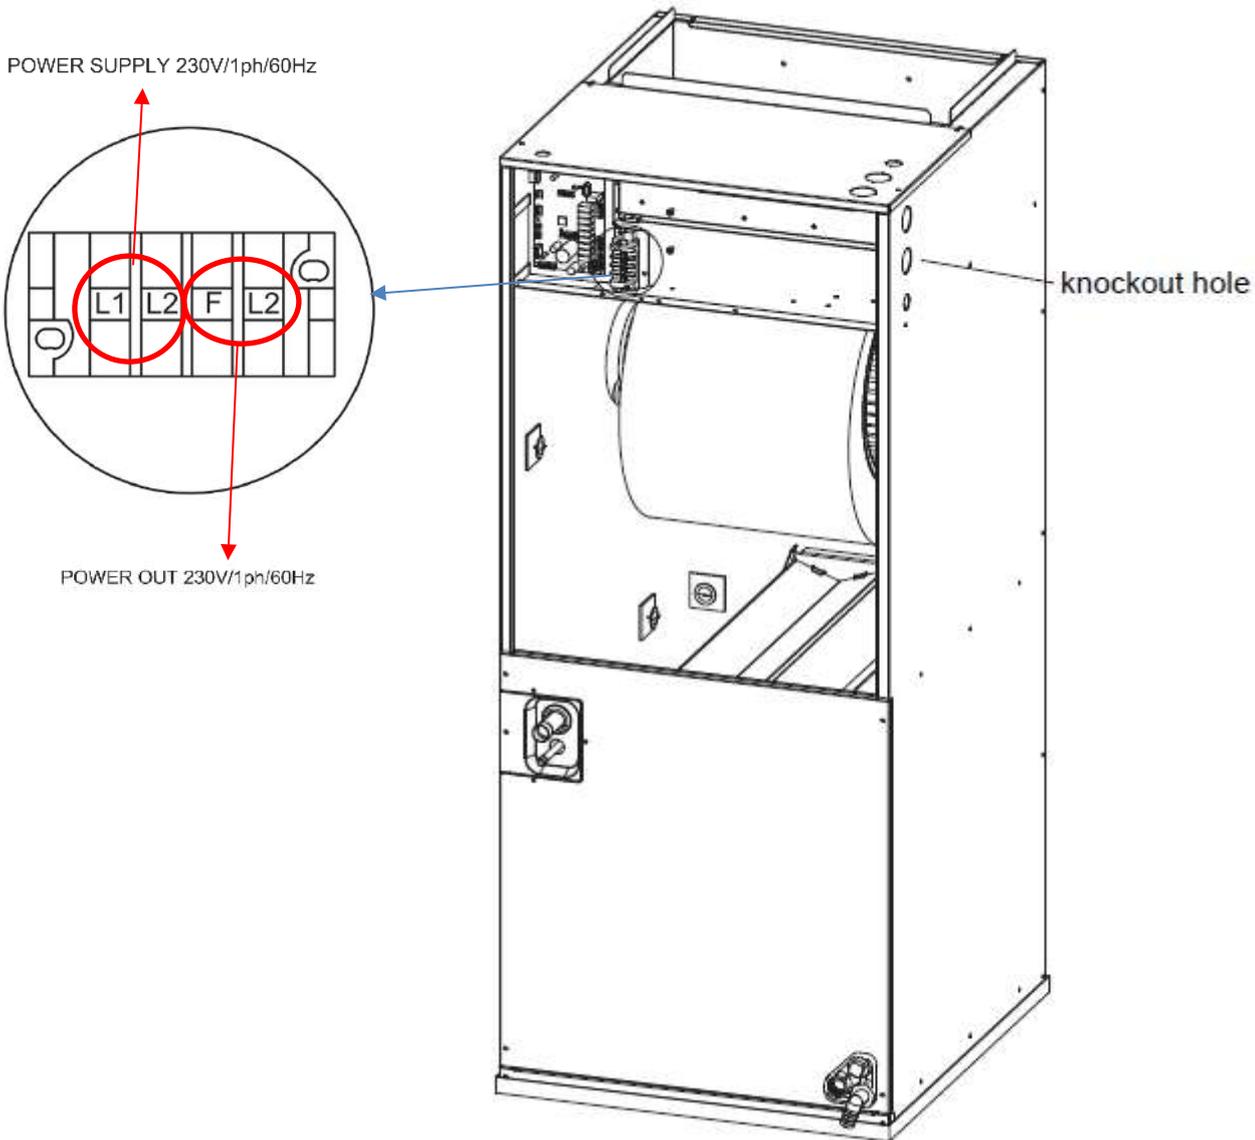

During installation, a buzzer or alarm light needs to be installed and connected to the terminal of AHU F/L2. When the AHU detects refrigerant leakage, F/L2 will output 220V voltage. Therefore, the buzzer will receive the signal and respond in time. When the refrigerant concentration reaches the threshold, the indoor airflow will run at the highest gear and the outdoor unit will stop.


Thermostat wiring

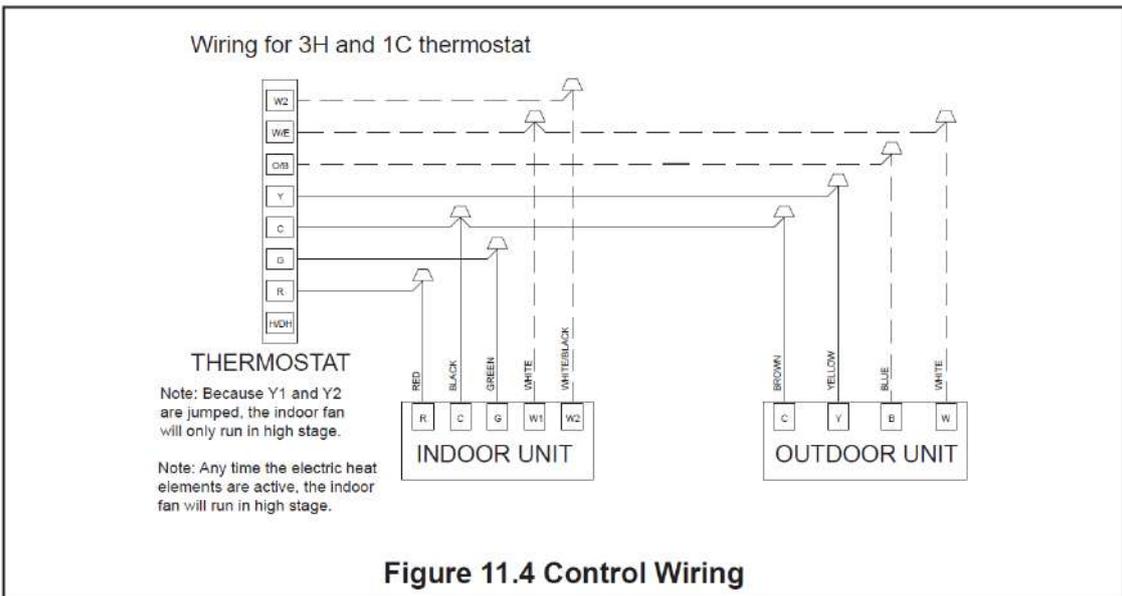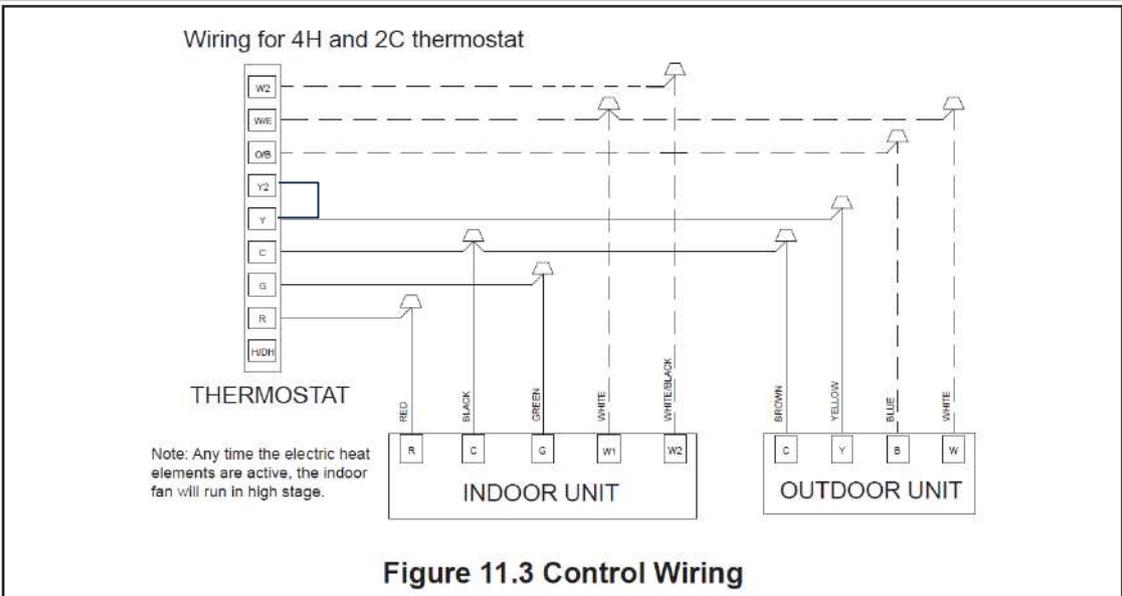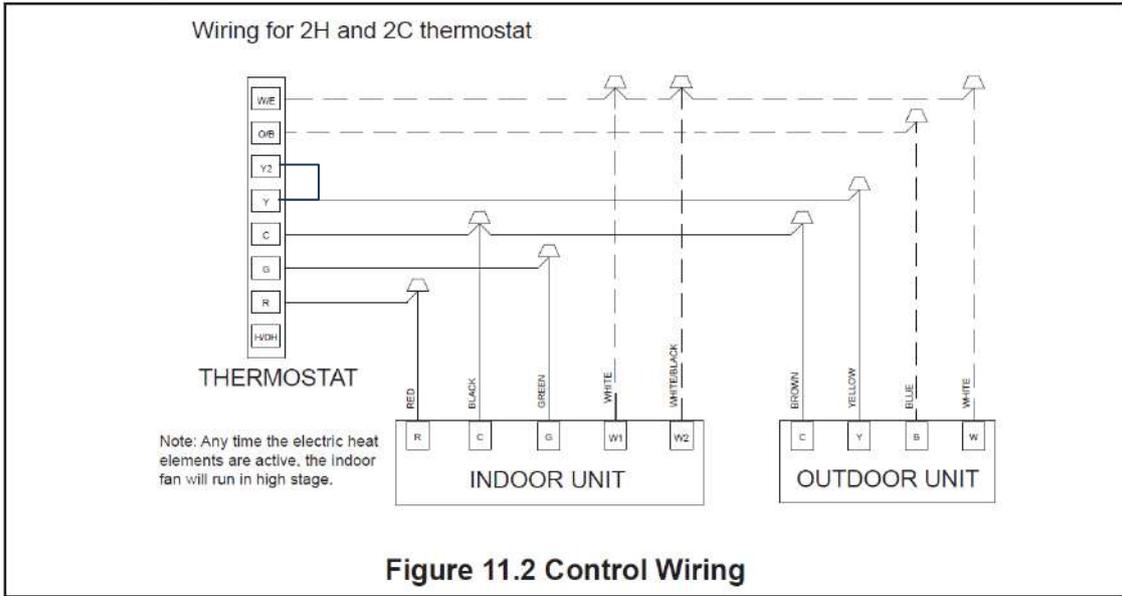

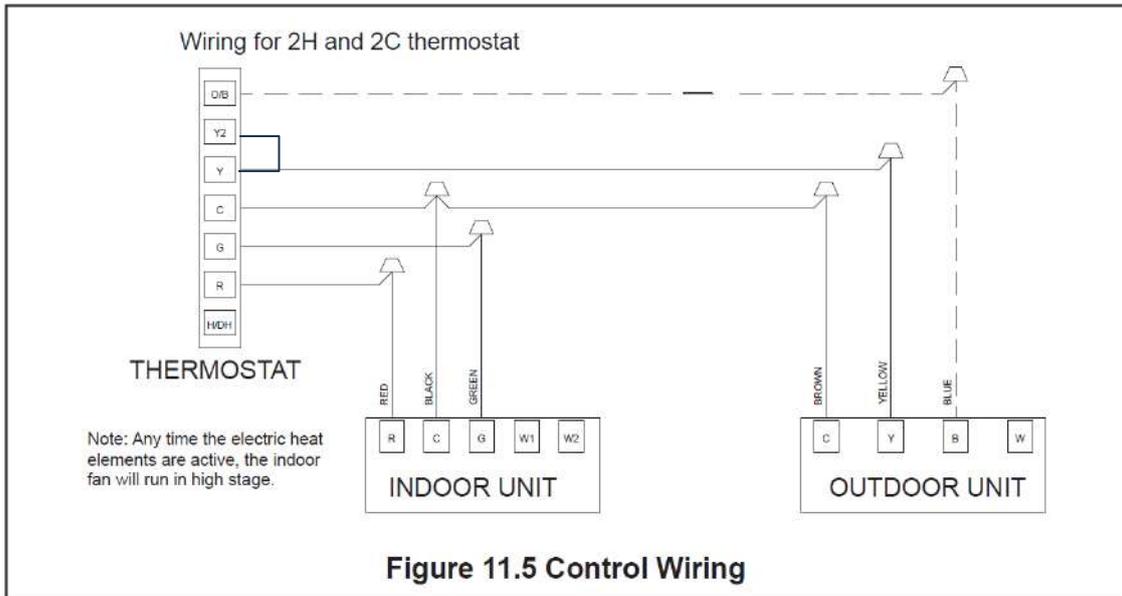

Note: Any time the electric heat elements are active, the indoor fan will run in high stage.


Figure 11.5 Control Wiring

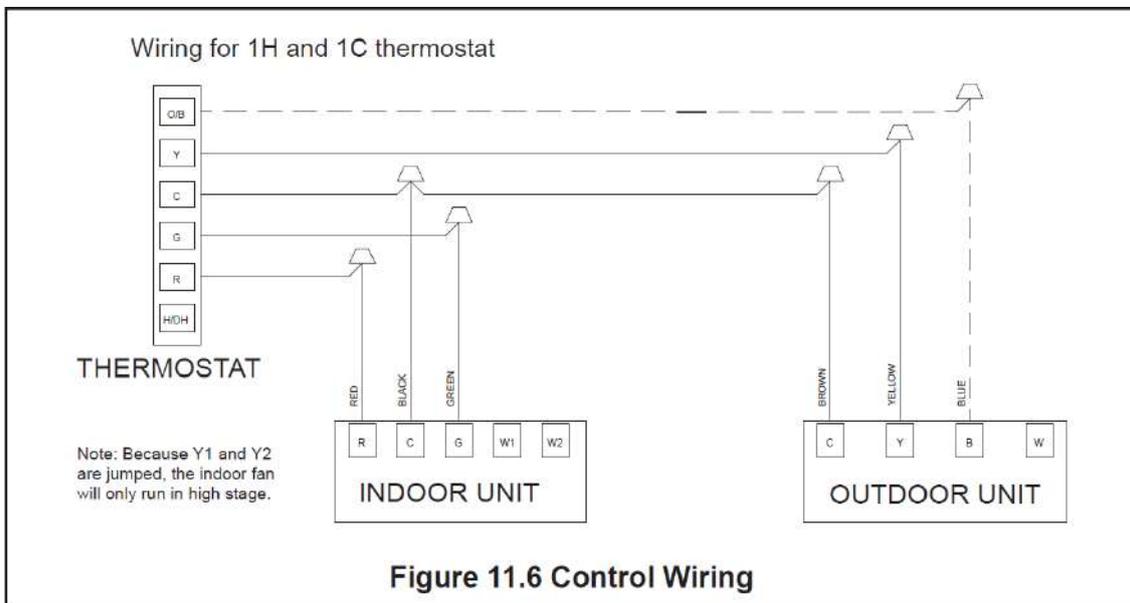

Note: Because Y1 and Y2 are jumped, the indoor fan will only run in high stage.

Figure 11.6 Control Wiring

12.Exploded View

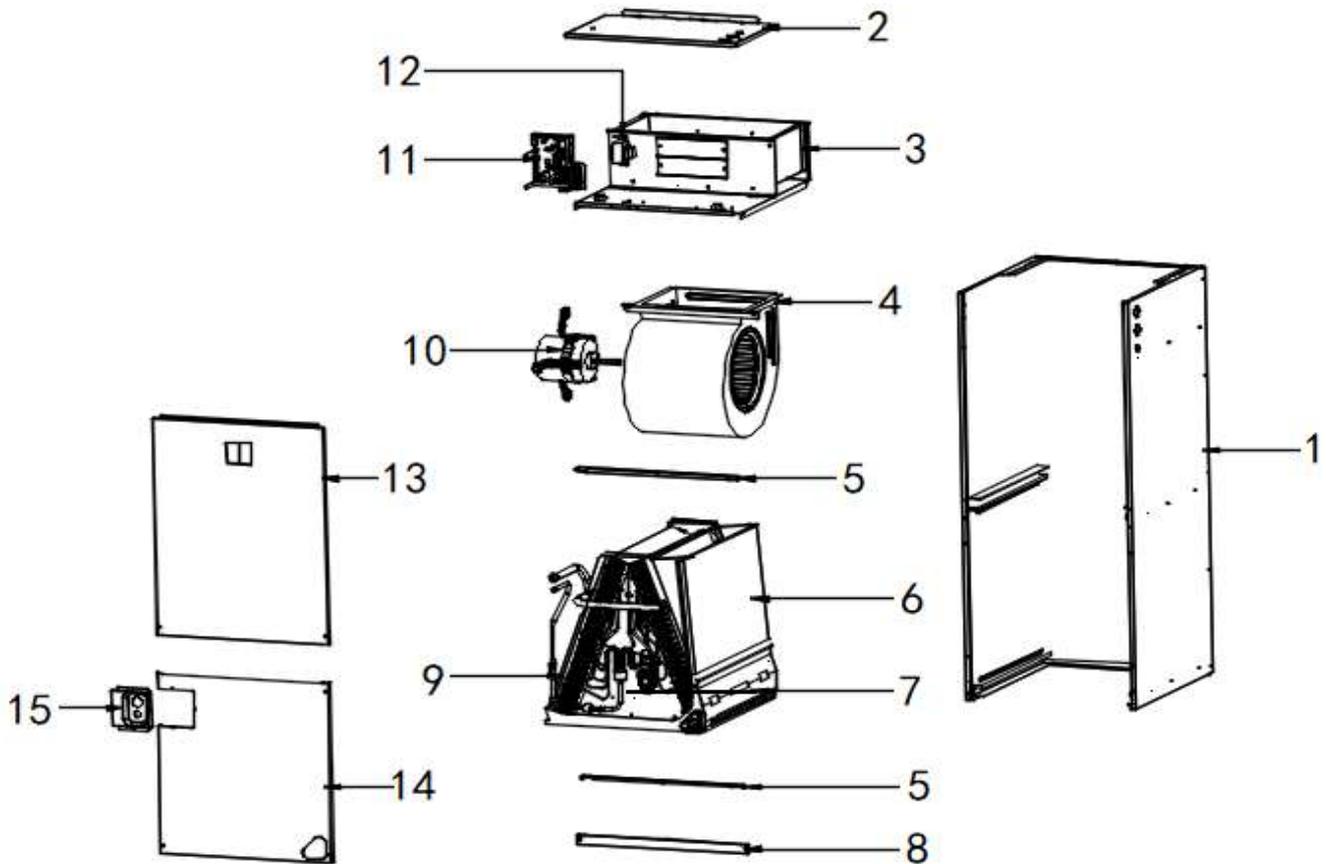

No.	Part Name	Quantity	No.	Part Name	Quantity
1	Rear Enclosure Assembly	1	9.3	Evaporator baffle	2
2	Control box cover assembly	1	10	DC Motor	1
3	Duct assembly	1	11	Indoor electric control box assembly	1
4	Right Volute Wind Wheel	1	11.1	Indoor main control board	1
5	Support bar	2	11.2	Ambient temperature sensor	1
6	Water pan components	1	11.3	Coil temperature sensor	1
7	Refrigerant leakage sensor	1	12	Transformers	1
8	Filter Cover plate	1	13	Upper side plate assembly	1
9	Evaporator components	1	14	Down side plate assembly	1
9.1	Evaporator output tube assembly	1	15	Pipe Cover plate assembly	1
9.2	Evaporator input tube assembly	1			

Part 3 Outdoor Unit

1.Specification.....	25
2.Dimensions	33
3.Service Space	34
4.Wiring Diagrams.....	35
5.Electric Characteristics.....	36
6.Operation Limits	36
7.Sound Levels	36
8.Exploded View	37
9.Troubleshooting	39

1.Specification

		HEAT PUMP				
Model			CP143S18 HPCO	CP143S24 HPCO	CP143S30 HPCO	CP143S36 HPCO
Outdoor power supply		V/Ph/H z	230V/1N/6 0HZ	230V/1N/6 0HZ	230V/1N/6 0HZ	230V/1N/6 0HZ
Cooling	Capacity	Btu/h	18000	23000	27600	33400
	EER2	Btu/h. W	11.7	11.7	12	11.7
	SEER2	Btu/h. W	14.3	14.3	15.2	14.3
Heating	Capacity	Btu/h	17600	22400	27800	33000
	HSPF2	Btu/h. W	7.5	7.5	7.5	7.5
Refer to Room Area	square feet		277.00	362.00	441.00	516.00
Max. input consumption		W	/	/	/	/
Max. current		A	/	/	/	/
MCA		A	13	13	20	30
MOP		A	15	20	25	40
Compressor	Brand		LG	LG	LG	LG
	Model		YPH016K AA	YPH020K AA	YPH024KA A	YPH029KA A
	Type		scroll	scroll	scroll	scroll
	Capacity	Btu/h	19500.00	24800.00	29700.00	36000.00
	Input	W	1192.00	1498.00	1772.00	2134.00
	Rated current(RLA)	A	6.80	8.70	10.10	14.00
	Locked rotor Amp(LRA)	A	47.00	59.00	71.00	75.00
Outdoor fan motor	Brand		Broad- Ocean	Broad- Ocean	Broad- Ocean	Broad- Ocean/Pan asonic
	Model		DRN-310- 200-10	DRN-310- 200-10	DRN-310- 200-10	DRN-310- 200-10
	Rate current	A	1.80	1.80	1.80	1.80
	Input	W	220.00	226.00	226.00	226.00
	Output	W	200.00	200.00	200.00	200.00
	Capacitor	μF	/	/	/	/
	Speed	rpm	850.00	850.00	950.00	950.00
Outdoor fan blade	Dimension	mm	Φ450×120 ×Φ12.7	Φ585×110 ×Φ12.7	Φ585×110 ×Φ12.7	Φ585×110 ×Φ12.7
Outdoor coil	Number of row		2.00	2.00	2.00	2.00
	Fin spacing	in	0.06	0.06	0.06	0.06
	Fin material		Hydrophilic Aluminium Fin	Hydrophilic Aluminium Fin	Hydrophilic Aluminium Fin	Hydrophilic Aluminium Fin
	Tube outside diameter	in	Φ 0.276	Φ 0.276	Φ 0.276	Φ 0.276

15SEER REGULAR SPLITS SYSTEM TECHNICAL MANUAL

	Tube material		Inner Grooved	Inner Grooved	Inner Grooved	Inner Grooved
	Coil length x height x width	in	54.68×23.14×1.05	54.68×23.14×1.05	84.09×23.15×1.05	84.09×23.15×1.05
	Number of circuit		6.00	6.00	6.00	6.00
Outdoor air flow		CFM	1780.00	3060.00	3350.00	3350.00
Outdoor noise level		dB(A)	57.00	60.00	60.00	60.00
Throttling type			Piston	Piston	Piston	Piston
Outdoor dimension	Unit (WxHxD)	in	21-4/5×25×21-4/5	21-4/5×25×21-4/5	29-1/7×25×29-1/7	29-1/7×25×29-1/7
		mm	554×633×554	554×633×554	740×633×740	740×633×740
	Packing (WxHxD)	in	22-3/5×25-9/10×22-3/5	22-3/5×25-9/10×22-3/5	29-9/10×25-9/10×29-9/10	29-9/10×25-9/10×29-9/10
		mm	575×660×575	575×660×575	775×680×775	775×680×775
	Net / Gross weight	kg	60/63	60.5/63	74.5/78.5	76/80.5
		lbs	132/139	133/139	164/173	168/177
Refrigerant	Type		R454b	R454b	R454b	R454b
	Charging	oz	82.89	82.89	116.40	125.22
Refrigerant pipe	Liquid side	in	Φ3/8	Φ3/8	Φ3/8	Φ3/8
	Gas side	in	Φ3/4	Φ3/4	Φ3/4	Φ3/4
	Max. refrigerant pipe length	ft	131	131	131	131
	Max. difference in level	ft	60	60	60	60
Design pressure		MPa	3.79/1.72	3.79/1.72	3.79/1.72	3.79/1.72
Max pressure		MPa	4.15	4.15	4.15	4.15
Operation temp range	Cooling	°F	53-120	53-120	53-120	53-120
	Heating	°F	5-80	5-80	5-80	5-80

HEAT PUMP						
Model			CP143S42HP CO	CP143S48H PCO	CP143S60HP CO	
Outdoor power supply		V/Ph/Hz	230V/1N/60HZ	230V/1N/60HZ	230V/1N/60HZ	
Cooling	Capacity	Btu/h	41000	46000	54000	
	EER2	Btu/h.W	11.7	11.2	11.2	
	SEER2	Btu/h.W	14.3	14.3	14.3	
Heating	Capacity	Btu/h	40600	45600	54000	
	HSPF2	Btu/h.W	7.5	7.5	7.5	
Refer to	square feet		630.00	748.00	785.00	

15SEER REGULAR SPLITS SYSTEM TECHNICAL MANUAL

Room Area					
Max. input consumption	W	/	/	/	/
Max. current	A	/	/	/	/
MCA	A	25	30	/	/
MOP	A	35	40	/	/
Compressor	Brand		LG	LG	LG
	Model		YPH036KAA	YBH042KAA	YBH049KAA
	Type		scroll	scroll	scroll
	Capacity	Btu/h	44700	52200	61400
	Input	W	2684	3115	3664
	Rated current(RLA)	A	12.6	14.5	16.2
	Locked rotor Amp(LRA)	A	96	102	125
Outdoor fan motor	Brand		Broad-Ocean/Panasonic	Broad-Ocean/Panasonic	Broad-Ocean/Panasonic
	Model		DRN-310-200-10	DRN-310-200-10	DRN-310-200-10
	Rate current	A	1.80	1.80	1.80
	Input	W	256.00	256.00	256.00
	Output	W	200.00	200.00	200.00
	Capacitor	μF	/	/	/
	Speed	rpm	950.00	1050.00	1100.00
Outdoor fan blade	Dimension	mm	φ595×115×φ12.7	φ595×115×φ12.7	φ595×115×φ12.7
Outdoor coil	Number of row		2.70	2.70	2.70
	Fin spacing	in	0.06	0.06	0.06
	Fin material		Hydrophilic Aluminium Fin	Hydrophilic Aluminium Fin	Hydrophilic Aluminium Fin
	Tube outside diameter	in	Φ 0.276	Φ 0.276	Φ 0.276
	Tube material		Inner Grooved	Inner Grooved	Inner Grooved
	Coil length x height x width	in	84.65×31.48×1.05	84.65×31.48×1.05	84.65×31.48×1.05
	Number of circuit		8.00	8.00	8.00
Outdoor air flow	CFM	3540.00	3910.00	4100.00	
Outdoor noise level	dB(A)	60.00	63.00	63.00	
Throttling type		Piston	Piston	Piston	
Outdoor dimension	Unit (WxHxD)	in	29-1/7×32-7/8×29-1/7	29-1/7×32-7/8×29-1/7	29-1/7×32-7/8×29-1/7
		mm	740×835×740	740×835×740	740×835×740
	Packing (WxHxD)	in	29-9/10×34-2/5×29-9/10	29-9/10×34-2/5×29-9/10	29-9/10×34-2/5×29-9/10
		mm	760×875×760	775×875×775	760×875×760
	Net / Gross	kg	83/89	'92/96	'98/103

15SEER REGULAR SPLITS SYSTEM TECHNICAL MANUAL

	weight	lbs	183/196	203/212	216/227
Refrigerant	Type		R454b	R454b	R454b
	Charging	oz	137.56	156.15	172.84
Refrigerant pipe	Liquid side	in	Φ3/8	Φ3/8	Φ3/8
	Gas side	in	Φ3/4	Φ7/8	Φ7/8
	Max. refrigerant pipe length	ft	131	147	147
	Max. difference in level	ft	60	60	60
Design pressure		MPa	3.79/1.72	3.79/1.72	3.79/1.72
Max pressure		MPa	4.15	4.15	4.15
Operation temp range	Cooling	°F	53-120	53-120	53-120
	Heating	°F	5-80	5-80	5-80

15SEER REGULAR SPLITS SYSTEM TECHNICAL MANUAL

COOL ONLY						
Model			CP143S18 SCCO	CP143S24 SCCO	CP143S30S CCO	CP143S36S CCO
Outdoor power supply		V/Ph/ Hz	230V/1N/60 HZ	230V/1N/60 HZ	230V/1N/60 HZ	230V/1N/60 HZ
Cooling	Capacity	Btu/h	18000	23000	27600	33400
	EER2	Btu/h. W	11.7	11.7	12	11.7
	SEER2	Btu/h. W	14.3	14.3	15.2	14.3
Refer to Room Area	square feet		277.00	362.00	441.00	516.00
Max. input consumption		W	/	/	/	/
Max. current		A	/	/	/	/
MCA		A	13	13	15	25
MOP		A	15	20	20	35
Compress or	Brand		LG	LG	LG	LG
	Model		YPH016KA A	YPH020KA A	YPH024KA A	YPH029KA A
	Type		scroll	scroll	scroll	scroll
	Capacity	Btu/h	19500.00	24800.00	29700.00	36000.00
	Input	W	1192.00	1498.00	1772.00	2134.00
	Rated current(RLA)	A	6.80	8.70	10.10	14.00
	Locked rotor Amp(LRA)	A	47.00	59.00	71.00	75.00
Outdoor fan motor	Brand		Broad- Ocean	Broad- Ocean	Broad- Ocean	Broad- Ocean
	Model		DRN-310- 200-10	DRN-310- 200-10	DRN-310- 200-10	DRN-310- 200-10
	Rate current	A	1.10	1.10	1.30	1.30
	Input	W	220	226	226	226
	Output	W	200	200	200	200
	Capacitor	μF	/	/	/	/
	Speed	rpm	850	950	950	950
Outdoor fan blade	Dimension	mm	Φ450×120× Φ12.7	Φ450×120× Φ12.7	Φ585×110× Φ12.7	Φ585×110× Φ12.7
Outdoor coil	Number of row		2	2	2	2
	Fin spacing	in	0.055	0.055	0.055	0.055
	Fin material		Hydrophilic Aluminium Fin	Hydrophilic Aluminium Fin	Hydrophilic Aluminium Fin	Hydrophilic Aluminium Fin
	Tube outside diameter	in	Φ 0.276	Φ 0.276	Φ 0.276	Φ 0.276
	Tube material		Inner Grooved	Inner Grooved	Inner Grooved	Inner Grooved
	Coil length x height x	in	55.00×23.1 5×1.05	55.00×23.1 5×1.05	84.09×23.15 ×1.05	84.09×23.15 ×1.05

15SEER REGULAR SPLITS SYSTEM TECHNICAL MANUAL

	width					
	Number of circuit		6	6	6	6
Outdoor air flow		CFM	1780	1990	3350	3350
Outdoor noise level		dB(A)	59	60	60	60
Throttling type			Piston	Piston	Piston	Piston
Outdoor dimension	Unit (WxHxD)	in	21-4/5×25×21-4/5	21-4/5×25×21-4/5	29-1/7×25×29-1/7	29-1/7×25×29-1/7
		mm	554×633×554	554×633×554	740×633×740	740×633×740
	Packing (WxHxD)	in	22-3/5×25-9/10×22-3/5	22-3/5×25-9/10×22-3/5	30-1/2×26-3/4×x30-1/2	29-9/10×25-9/10×x29-9/10
		mm	575×660×575	575×660×575	775×680×775	775×680×775
	Net / Gross weight	kg	57/60	57.5/60	71.5/76	72.5/77
		lbs	126/132	127/132	158/168	160/170
Refrigerant	Type		R454b	R454b	R454b	R454b
	Charging	oz	70.55	75.84	116.40	123.46
Refrigerant pipe	Liquid side	in	Φ3/8	Φ3/8	Φ3/8	Φ3/8
	Gas side	in	Φ3/4	Φ3/4	Φ3/4	Φ3/4
	Max. refrigerant pipe length	ft	131	131	131	131
	Max. difference in level	ft	60	60	60	60
Design pressure		MPa	3.79/1.72	3.79/1.72	3.79/1.72	3.79/1.72
Max pressure		MPa	4.15	4.15	4.15	4.15
Operation temp range	Cooling	°F	53-120	53-120	53-120	53-120

COOL ONLY						
Model			CP143S42SC CO	CP143S48SC CO	CP143S60SC CO	
Outdoor power supply		V/Ph/Hz	230V/1N/60HZ	230V/1N/60HZ	230V/1N/60HZ	
Cooling	Capacity	Btu/h	41000	46000	54000	
	EER2	Btu/h. W	11.7	11.2	11.2	
	SEER2	Btu/h. W	14.3	13.8	13.8	
Refer to Room Area	square feet		630.00	748.00	785.00	


15SEER REGULAR SPLITS SYSTEM TECHNICAL MANUAL

Max. input consumption		W	/	/	/
Max. current		A	/	/	/
MCA		A	25	30	33
MOP		A	35	40	45
Compressor	Brand		LG	LG	LG
	Model		YPH036KAA	YBH042KAA	YBH049KAA
	Type		scroll	scroll	scroll
	Capacity	Btu/h	44700	52200	61400
	Input	W	2684	3115	3664
	Rated current(RLA)	A	12.6	14.5	16.2
	Locked rotor Amp(LRA)	A	96	102	125
Outdoor fan motor	Brand		Broad-Ocean	Broad-Ocean	Broad-Ocean
	Model		DRN-310-200-10	DRN-310-200-10	DRN-310-200-10
	Rate current	A	1.70	1.70	1.70
	Input	W	256	256	256
	Output	W	200	200	200
	Capacitor	μF	/	/	/
	Speed	rpm	1050	1050	1050
Outdoor fan blade	Dimension	mm	Φ585×110×Φ12.7	Φ585×110×Φ12.7	Φ595×115×Φ12.7
Outdoor coil	Number of row		2	2	2.7
	Fin spacing	in	0.055	0.055	0.055
	Fin material		Hydrophilic Aluminium Fin	Hydrophilic Aluminium Fin	Hydrophilic Aluminium Fin
	Tube outside diameter	in	Φ 0.276	Φ 0.276	Φ 0.276
	Tube material		Inner Grooved	Inner Grooved	Inner Grooved
	Coil length x height x width	in	84.65×31.48×1.05	84.65×31.48×1.05	84.65×31.48×1.05
	Number of circuit		/	/	/
Outdoor air flow		CFM	3820	3820	3820
Outdoor noise level		dB(A)	63	63	63
Throttling type			Piston	Piston	Piston
Outdoor dimension	Unit (WxHxD)	in	29-1/7×32-7/8×29-1/7	29-1/7×32-7/8×29-1/7	29-1/7×32-7/8×29-1/7
		mm	740×835×740	740×835×740	740×835×740
	Packing (WxHxD)	in	29-9/10×34-2/5×29-9/10	29-9/10×34-2/5×29-9/10	29-9/10×34-2/5×29-9/10
		mm	760×875×760	760×875×760	760×875×760
	Net / Gross weight	kg	80/84	89/94	94/98
lbs		176/185	196/207	207/216	
Refrigerant	Type		R454b	R454b	R454b
	Charging	oz	124.45	134.04	165.78
Refrigerant pipe	Liquid side	in	Φ3/8	Φ3/8	Φ3/8
	Gas side	in	Φ3/4	Φ7/8	Φ7/8
	Max. refrigerant pipe	ft	131	147	147

15SEER REGULAR SPLITS SYSTEM TECHNICAL MANUAL


	length				
	Max. difference in level	ft	60	60	60
Design pressure		MPa	3.79/1.72	3.79/1.72	3.79/1.72
Max pressure		MPa	4.15	4.15	4.15
Operation temp range	Cooling	°F	53-120	53-120	53-120

2. Dimensions

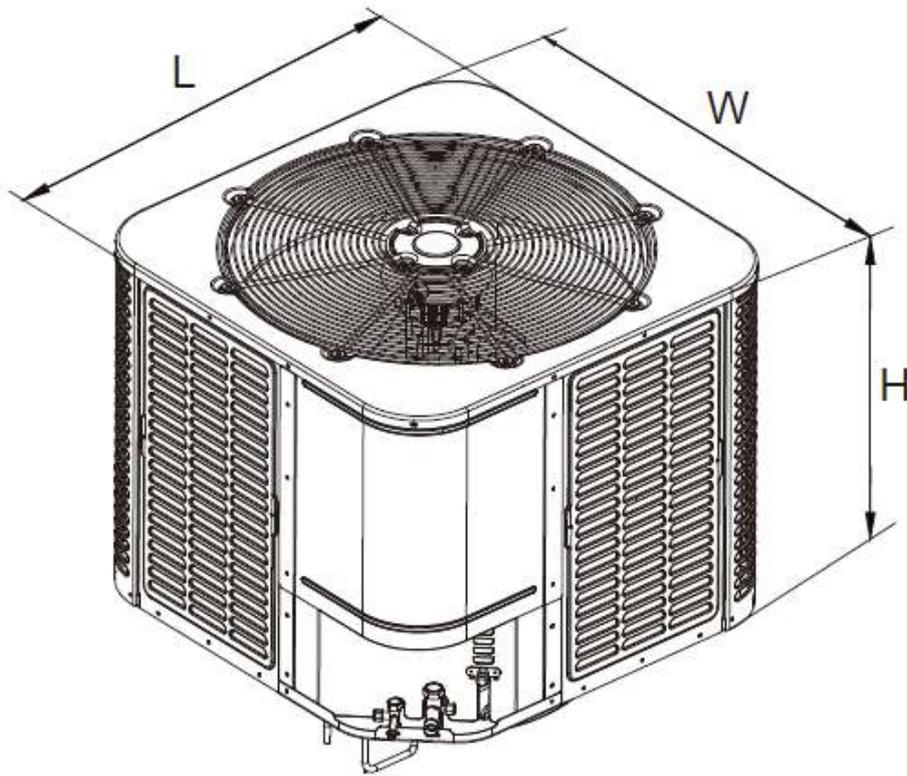


model	H×W×L (inches)
18K/24K	25 × 21-4/5 × 21-4/5
30K/36K	25 × 29-1/7 × 29-1/7
42K/48K/60K	32-7/8 × 29-1/7 × 29-1/7

3. Service Space

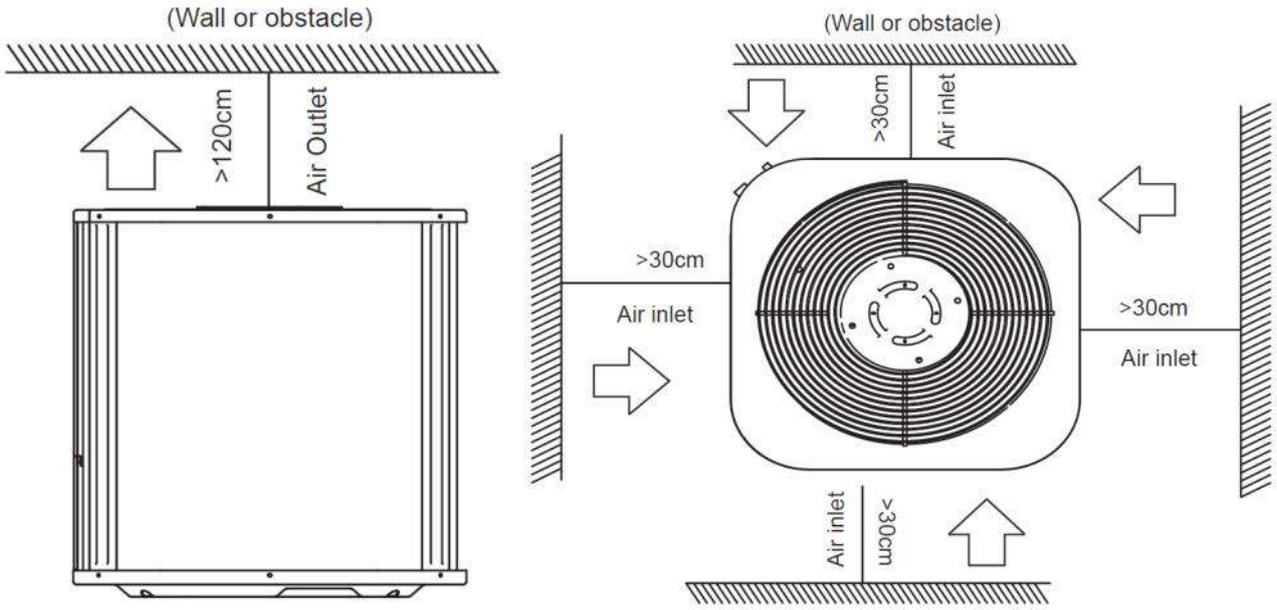


TYPICAL INSTALLATION

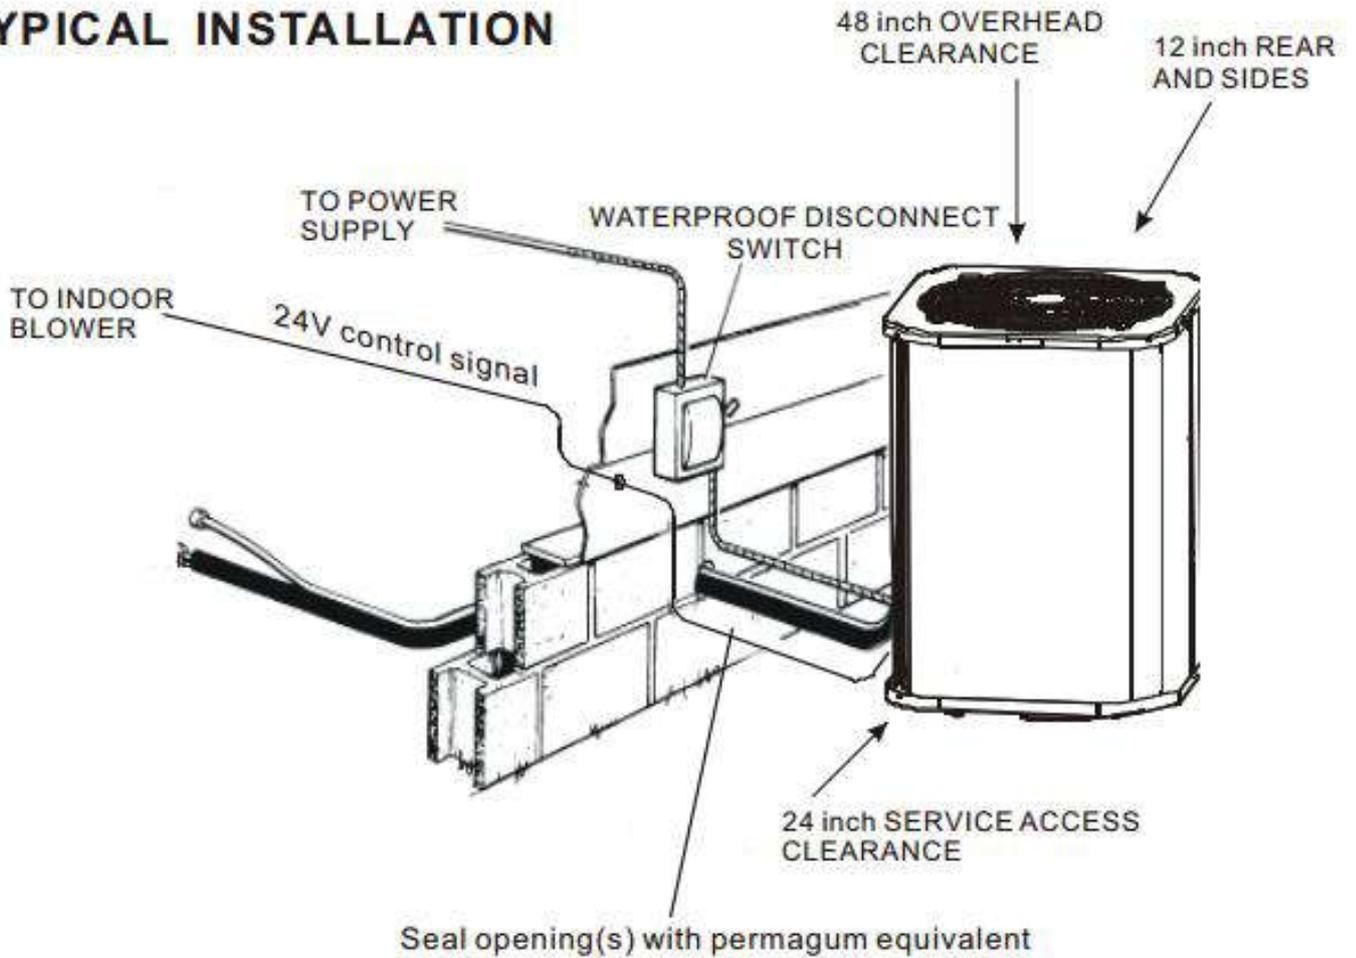


4. Wiring Diagrams.

Heat pump unit

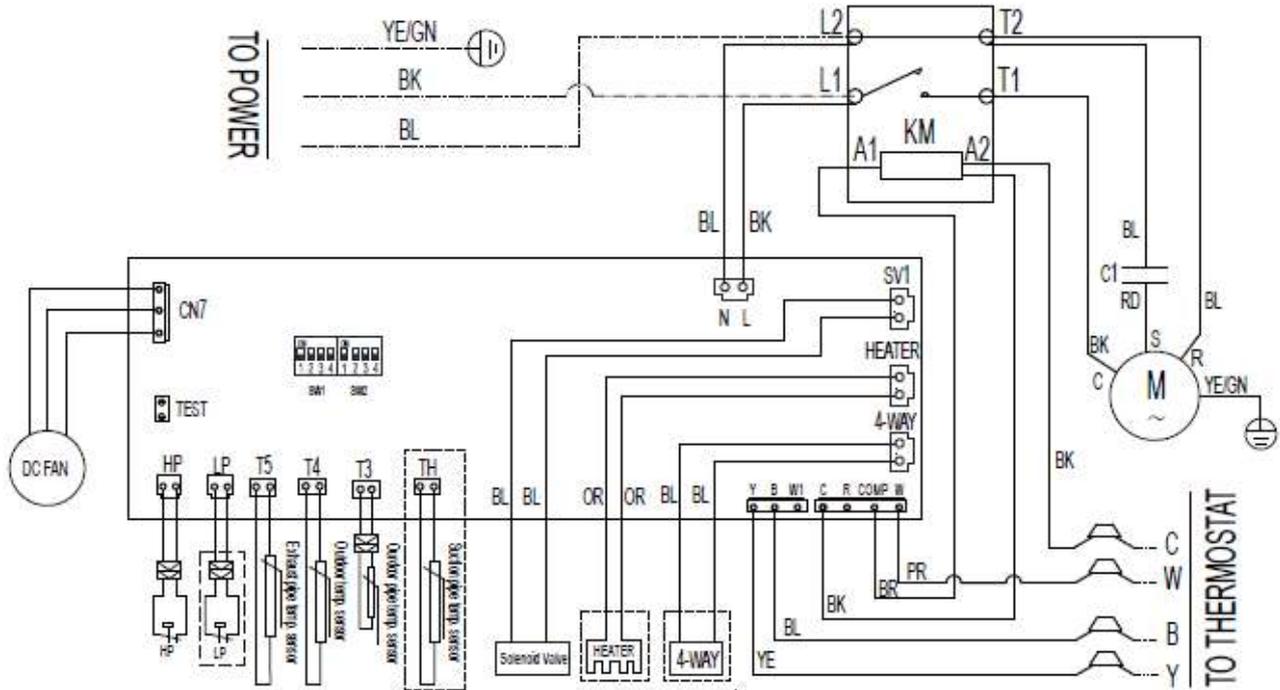

Cooling only unit

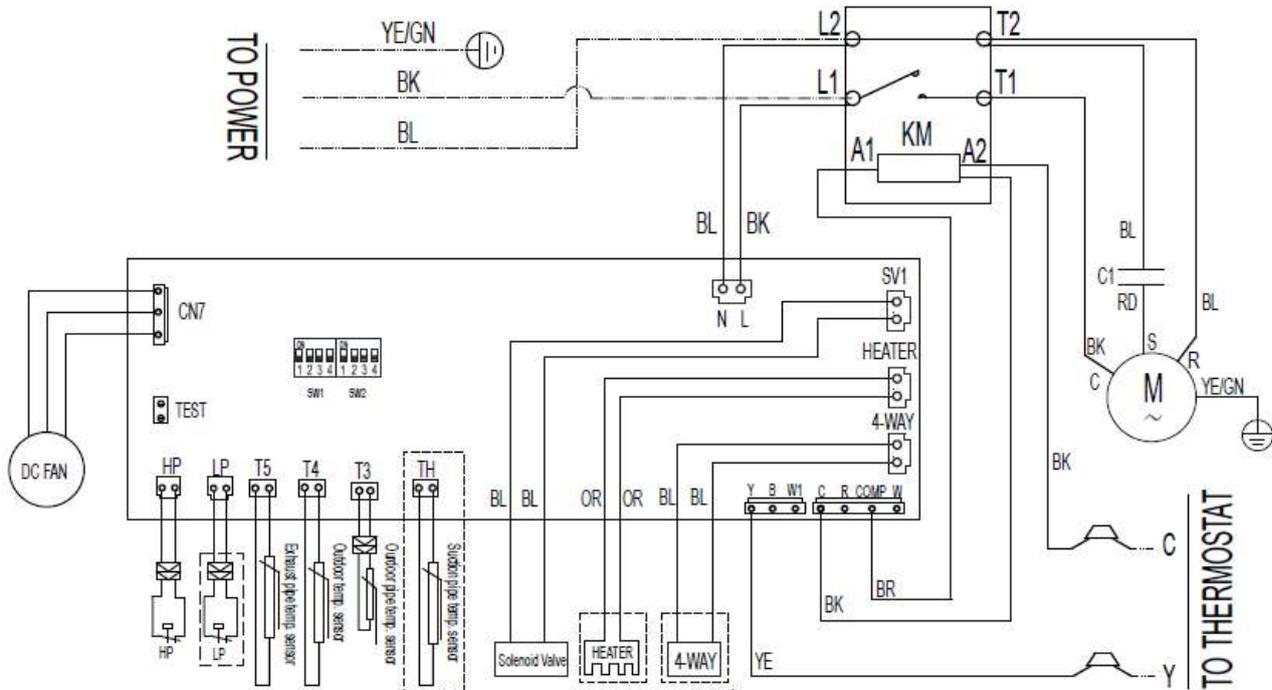


5. Electric Characteristics

Model	Outdoor Unit					
	Hz	Voltage	Min.	Max.	MCA	MOP
18K	60	208~230V	187V	253V	16	25
24K	60	208~230V	187V	253V	20	30
30K	60	208~230V	187V	253V	23	35
36K	60	208~230V	187V	253V	30	45
42K	60	208~230V	187V	253V	25	35
48K	60	208~230V	187V	253V	30	40
60K	60	208~230V	187V	253V	33	45

6. Operation Limits


Operation mode	Outdoor temperature(°F)	Room temperature(°F)
Cooling operation	53—118	61—90
Heating operation	5—80	61—90

7. Sound Levels

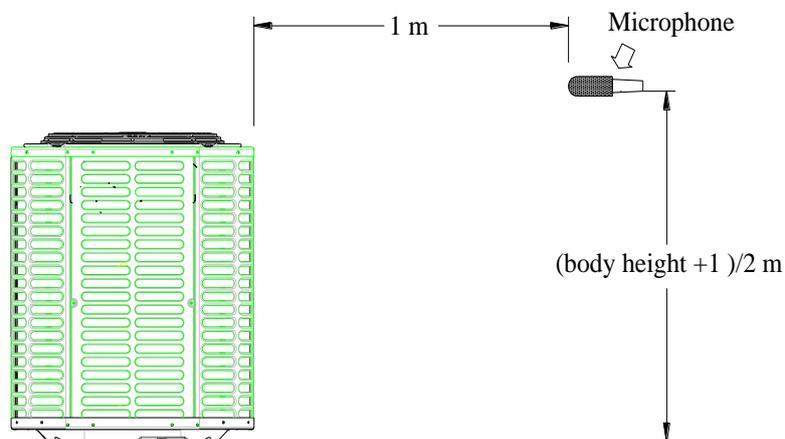

Note: Sound level is measured at a point 1 m in front of the unit, at a height of (Unit body height +1)/2 m.

8.Exploded View

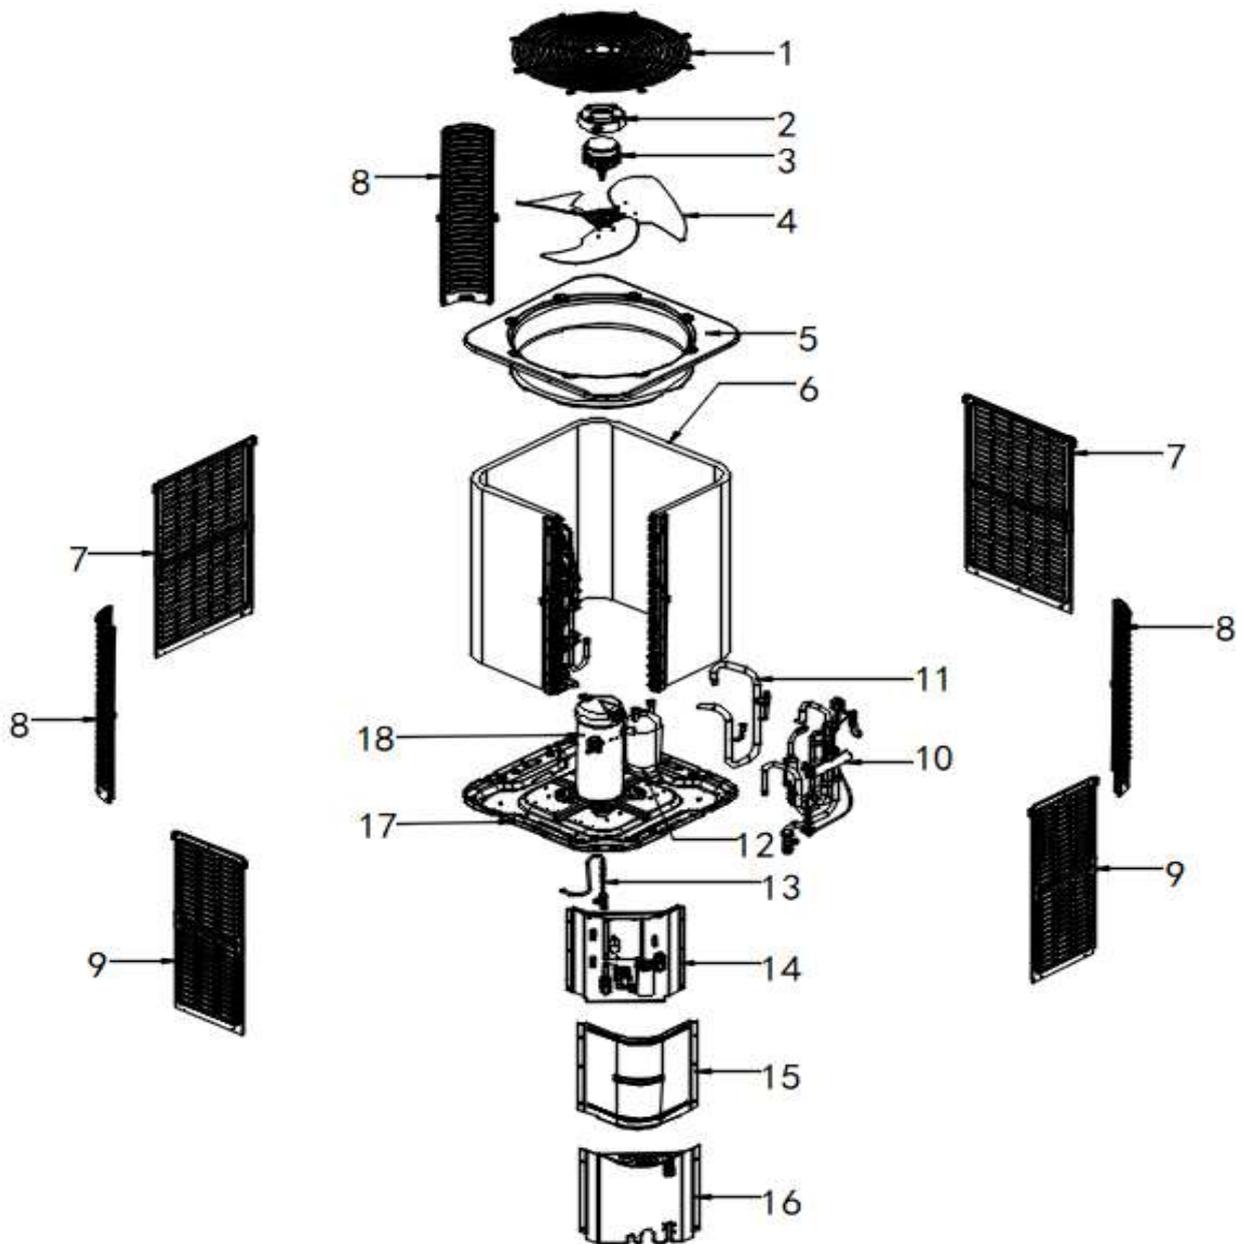

N o.	Part Name	Quantity	No.	Part Name	Quantity
1	Cover net	1	14	electric control box components	1
2	DC Motor Mount	1	14.1	Electronic control board	1
3	Outdoor motor	1	13.2	High pressure switch	1
4	Axial-flow fan	1	13.3	Low pressure switch	1
5	Top cover assembly	1	13.4	Condenser temperature sensor (T3)	1
6	Condenser assembly	1	13.5	Ambient temperature sensor (T4)	1
6.1	Condenser inlet pipe assembly	1	13.6	Exhaust temperature sensor (T5)	1
6.2	Condenser output pipe	1	13.7	Return temperature sensor	1

15SEER REGULAR SPLITS SYSTEM TECHNICAL MANUAL

2	assembly			(TH)	
7	Rear side-panel	2	13.8	Solenoid valve	1
8	Support board	3	13.9	AC contactor	1
9	Left side-panel	2	13.1 0	Compressor capacitor	1
10	Four way valve assembly	1	15	Top panel	1
11	Suction air pipe weld assembly	1	16	Bottom side panel	1
12	Gas-liquid separator	1	17	Chassis assembly	1
13	High pressure valve assembly	1	18	Compressor	1

9. Troubleshooting

9.1 Error code


Indoor unit

Number of green light flashes	Fault description
2	T1 sensor fault
3	T2 sensor fault
4	Refrigerant concentration sensor fault
5	Refrigerant leakage
6	Anti-freeze protection
7	Mainboard chip fault
8	Motor protection
9	IDU and ODU unit communication fault (RS485 communication mode)
10	Wire controller communication fault (RS485 communication mode)

Outdoor unit


status code	System status
0	Standby Mode
1	Cooling Mode
2	Heating Mode
3	T3 Sensor Error
4	T4 Sensor Error
5	T5 Sensor Error
6	Low Pressure Protection
7	High Pressure Protection
8	Outdoor Fan Error
9	T3 High Temperature Protection
A	T4 Ambient Temperature Protection
C	T5 High Compressor Discharge Temperature Protection
E	TH Sensor Error
F	TH Anti-freeze Protection
6.	6 times Low Pressure Protection within 60 minutes
7.	6 times High Pressure Protection within 60 minutes
8.	4 times Outdoor Fan Error within 60 minutes
C.	3 times T5 Temperature Protection within 60 minutes
F.	8 times TH Anti-freeze Protection within 200 minutes

9.2 Indoor unit control board

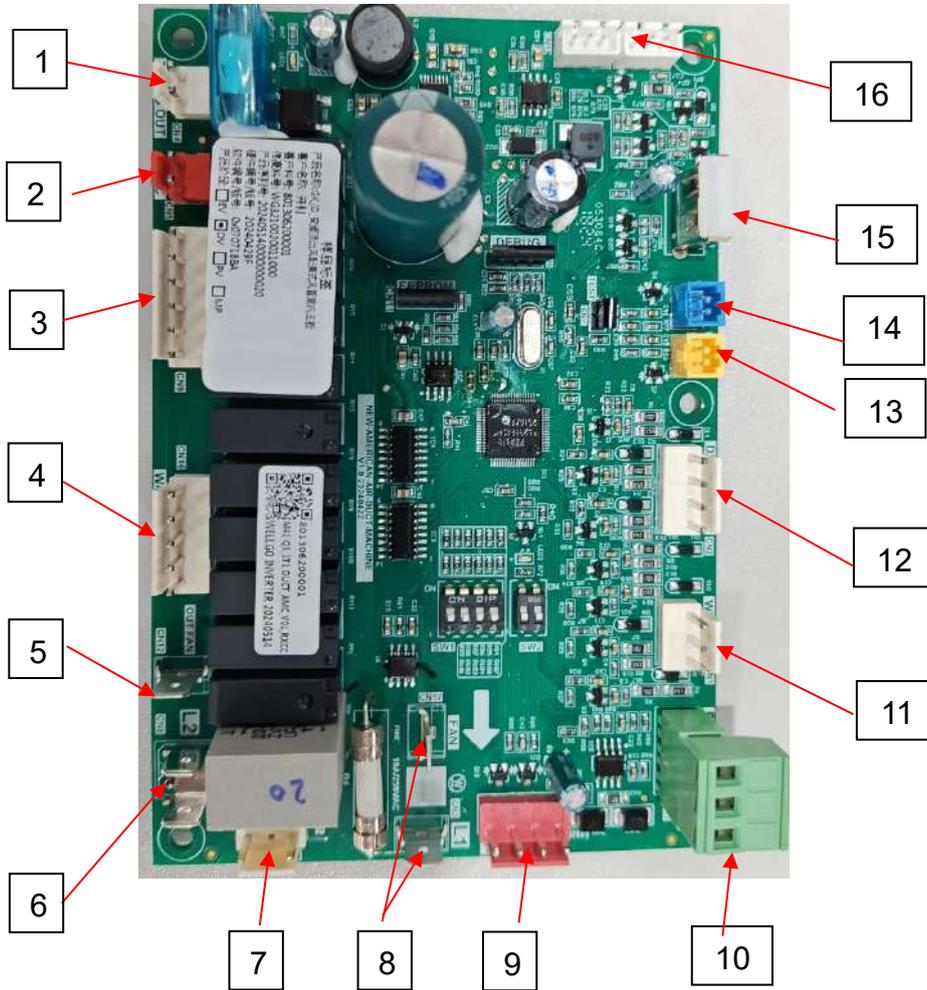

NUM	Port definition	NUM	Port definition
1	Transformer output (24v)	9	Refrigerant leakage sensor
2	24V thermostat power supply R, C	10	PQE indoor and outdoor communication
3	DC motor communicate port	11	Electric heater port (to 24V thermostat)
4	Electric heater port (connected to electric heater)	12	24V terminal connected to 24V thermostat
5	Power supply of control board and DC motor N (L2)	13	T1 sensor
6	Power supply (L2)	14	T2 sensor
7	Transformer input(230v)	15	Debug port
8	Power supply of control board and DC motor L (L1)	16	Smart controller port (only active functional in RS485 communication mode)

9.3 Outdoor unit control board

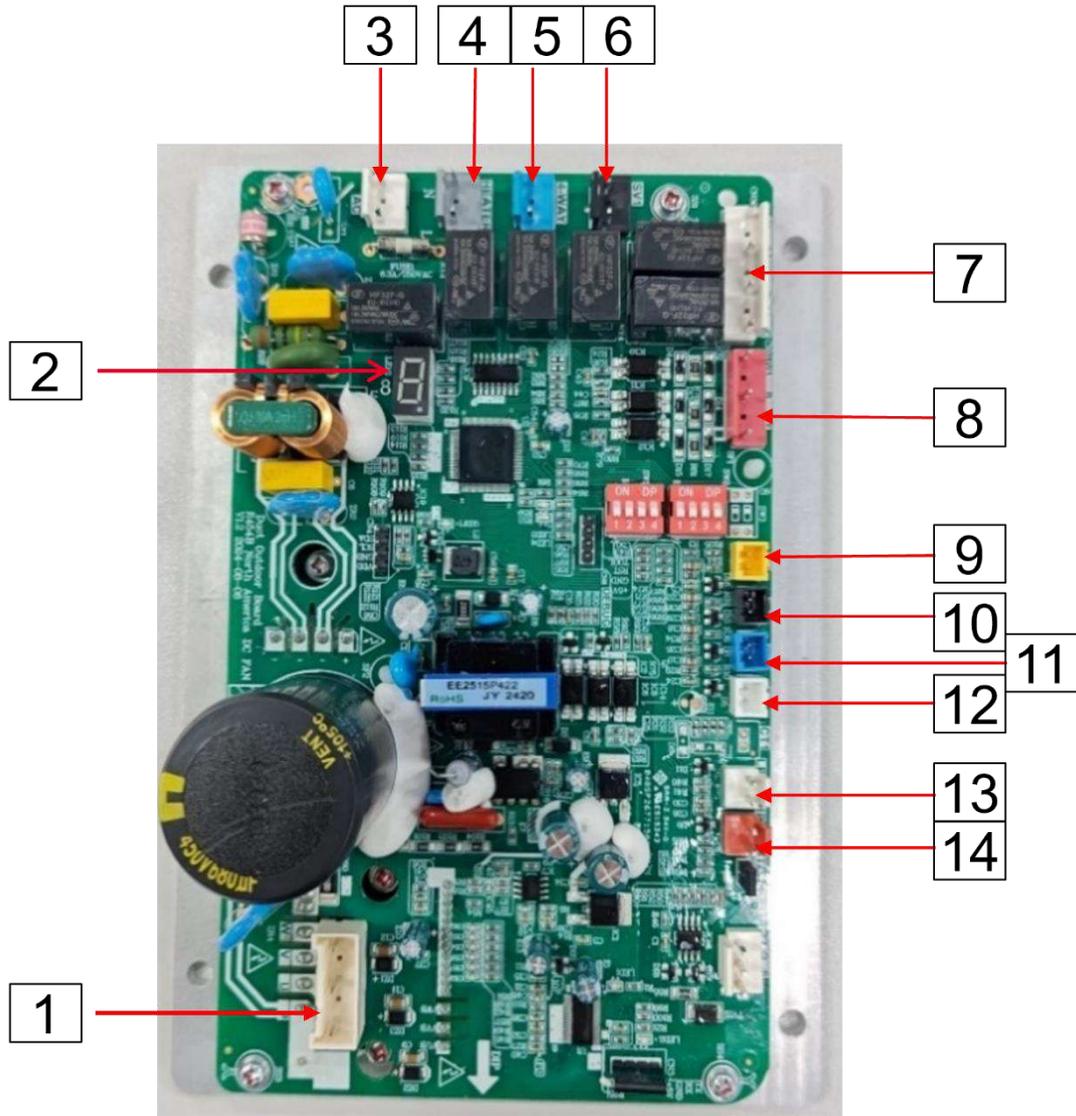


NUM	Port definition	NUM	Port definition
1	DC motor communicate port	8	24V communication (Y/B)
2	Digital display tube	9	Return air temperature sensor
3	Power supply	10	Condenser temperature sensor
4	Crankshaft heating belt	11	ambient temperature sensor
5	Four-way valve	12	Exhaust temperature sensor
6	Solenoid valve	13	Low pressure switch
7	24V communication (W/C)	14	High pressure switch

9.4 Troubleshooting guide

9.4.1 T1/T2/ sensor fault, R454b sensor fault (Indoor unit sensor failure)

9.4.2 T3/T4/T5 sensor fault (Outdoor unit sensor failure)

Reason: Sensor reading error

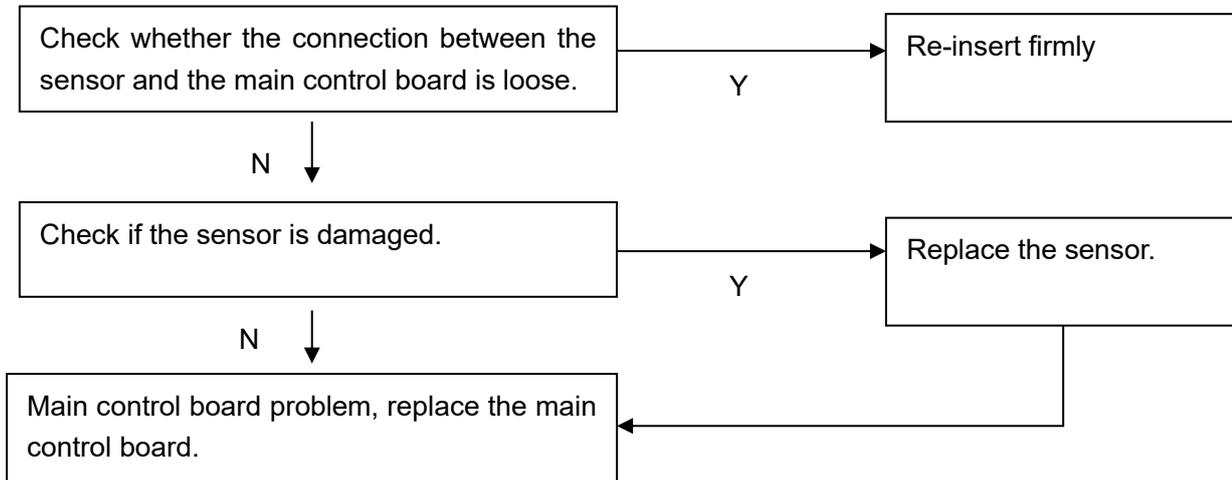

- Confirm whether the sensor is firmly connected and check the sensor connector to ensure it is firmly connected.
- Unplug the sensor and use a multimeter to measure the resistance to check whether it is open circuit or short circuit. If so, replace the sensor; if not, replace the main control board.



- Sensor resistance table see Appendix 1

9.4.3 Refrigerant leakage fault

Reason: Refrigerant leakage detected

- Firstly, open windows for ventilation and extinguish indoor open flames.
- Then check if there is any leakage in the copper pipe. If it is confirmed to be leaking, the pipe needs to be repaired by welding.
- If no leakage is found, it may be a false alarm fault on the main control board. Replace the indoor board first. If the fault is not resolved, replace the refrigerant sensor.

9.4.4 Indoor control board chip failure

Reason: The indoor control board chip is broken


- Replace the indoor control board.

9.4.5 Anti-freeze protection

Reason:

Indoor unit: The T2 sensor detects that the evaporator temperature is too low($T_2 < 0^\circ\text{C}$)

Outdoor unit: The TH sensor detects that the gas return temperature is too low($T_2 < 0^\circ\text{C}$)

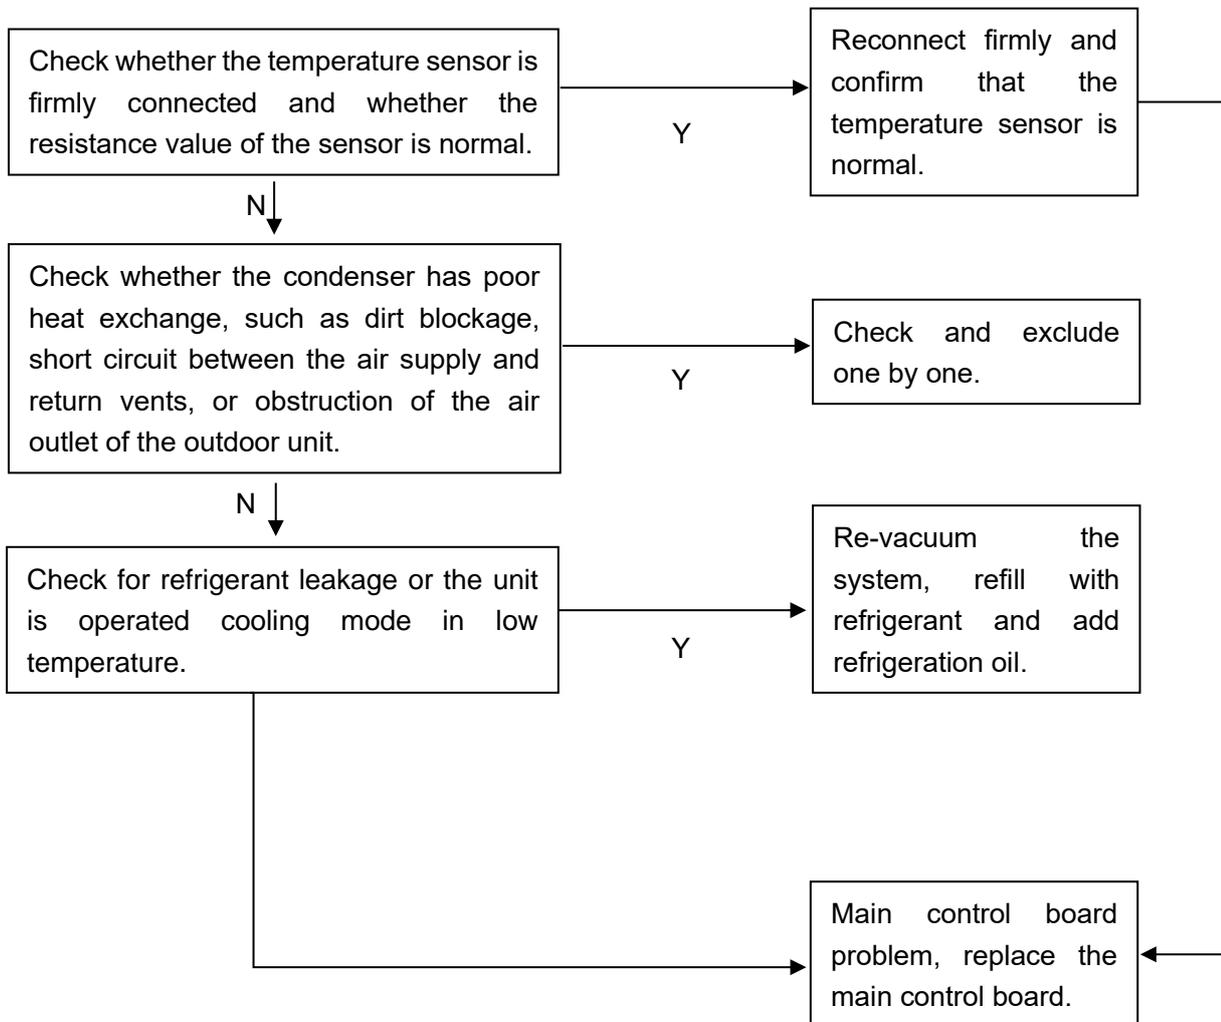

- Check if the actual temperature of the evaporator is very low or even frozen.
- If the evaporator is frozen, please check if the air conditioning system is blocked or if the refrigerant is leaking, etc. If no, then you need to clean the pipes, re-evacuate, and recharge refrigerant.
- If the evaporator is not frozen, use a multimeter to measure whether the resistance of the temperature sensor is normal (see the appendix for the R-T table). If it is not normal, you need to replace the sensor.
- If the sensor resistance is normal, then you need to replace the main control board of the indoor unit.


9.4.6 Indoor fan protection

Reason: The DC fan motor of the indoor unit has issue



- Replace the control board of the indoor unit.
- If not resolved, replace the motor.

9.4.7 High /Low pressure protection

Cause: The high and low-pressure switch is continuously in the disconnected state

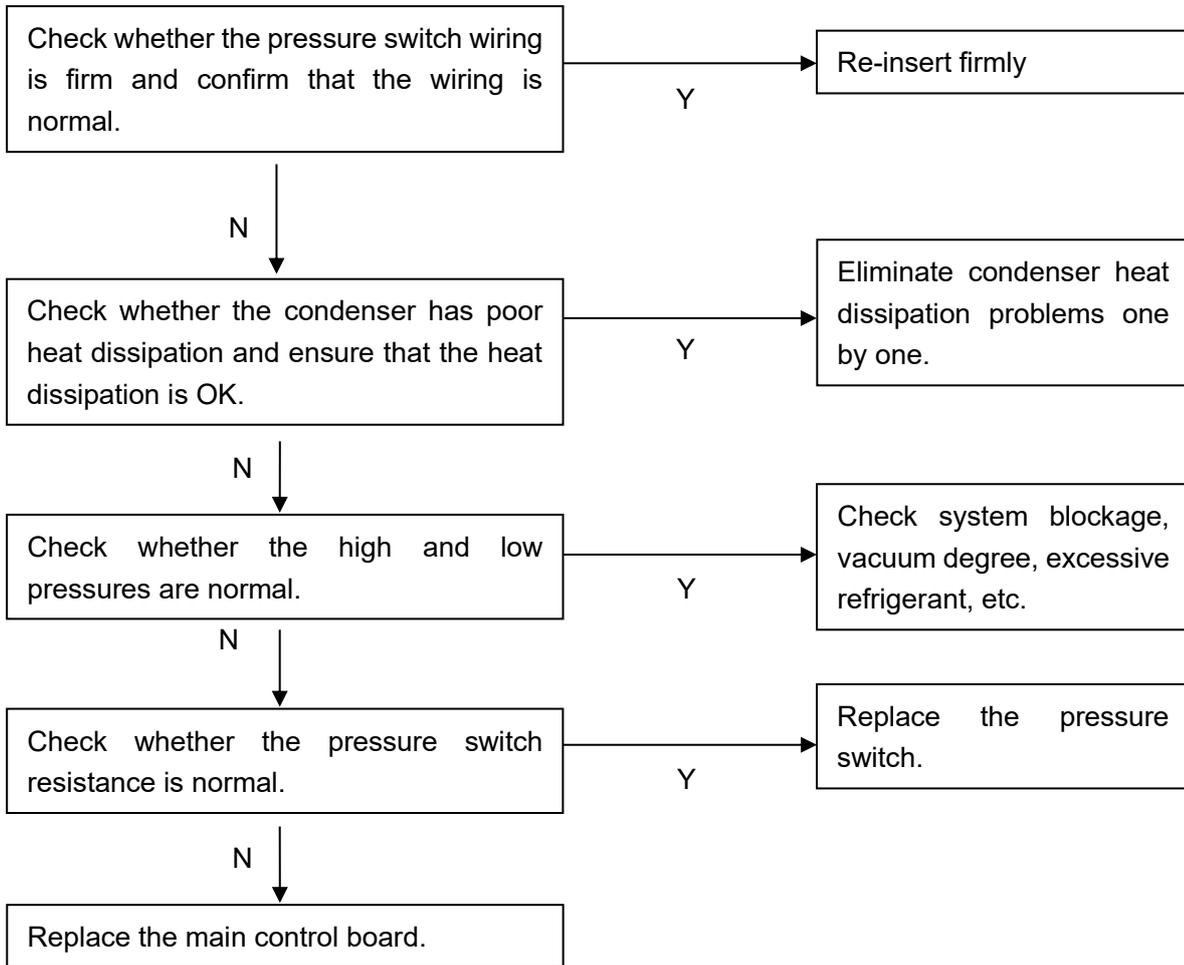


- Then turn off the power of the machine and then turn on the power, and use the controller to start the machine.
- If the machine fails after running for a while, there may be a problem with the refrigerant system and the system needs to be checked.
- If the machine fails as soon as it is powered on, there may be a problem with the pressure switch or the outdoor main board.
- Use a jump cap or metal short-circuit to connect the pressure switch port of the electronic control board, then turn off the power and restart the machine, and observe whether the fault disappears.
- If the fault is resolved, replace the pressure switch.
- If the fault is not resolved, replace the main control board.

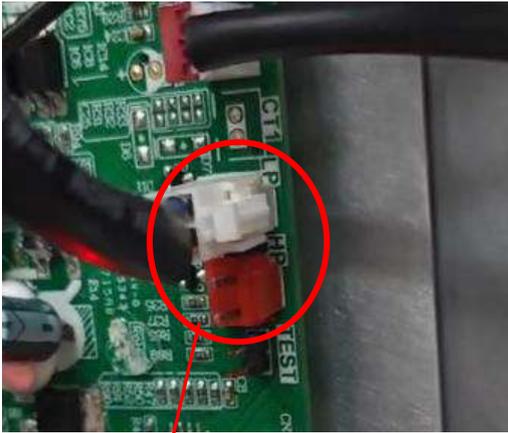


The high-pressure switch port can be short circuited by using a screw clamped between two pins.

9.4.8 DC fan malfunction

Cause: Abnormal detection of fan motor.

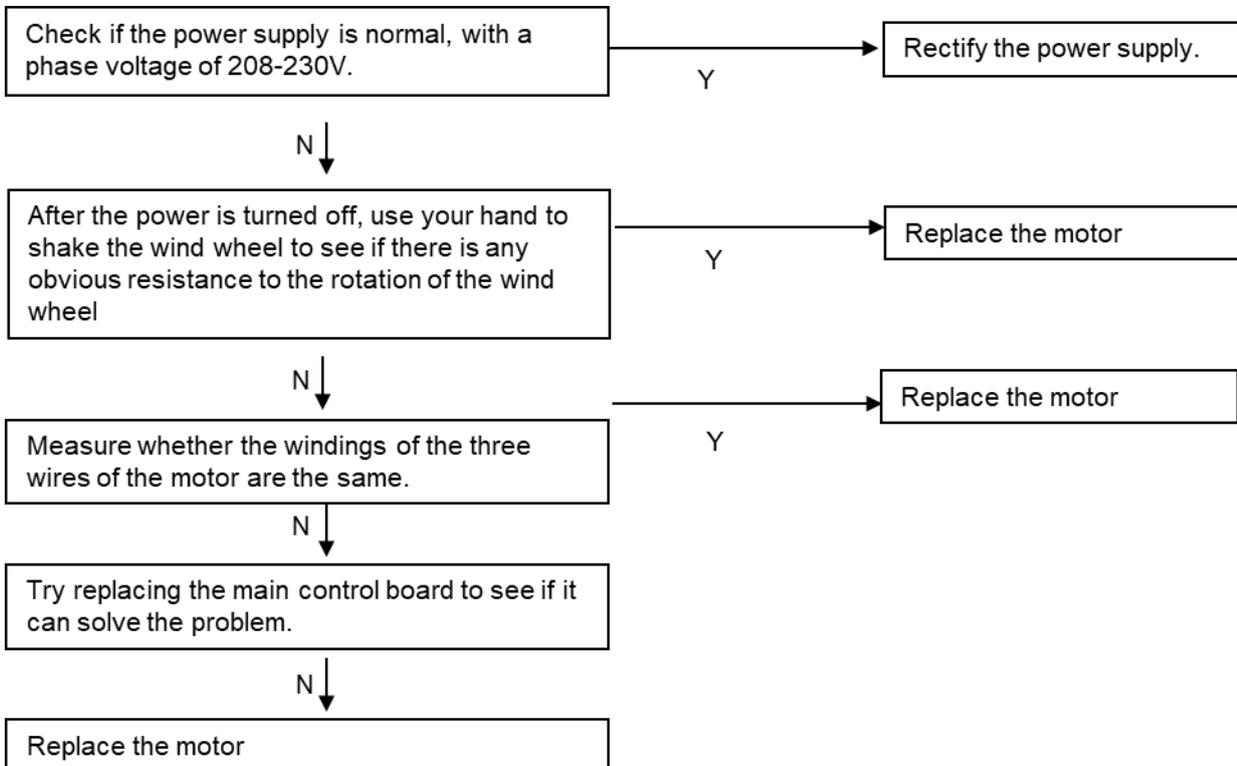


- Check if the power supply is normal, with a phase voltage of 208-230V, and confirm that the power supply is functioning properly.

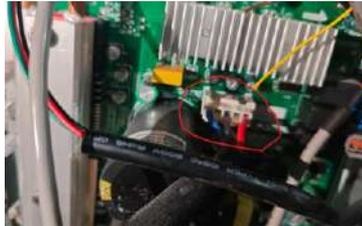


- After the power is turned off, use your hand to shake the wind wheel to see if there is any obvious resistance to the rotation of the wind wheel. If you find that the wind wheel does not rotate smoothly when you turn it by hand, replace the motor, otherwise proceed to the next step.
- Measure whether the windings of the three wires of the motor are the same. If the winding cannot be measured, or the measured resistance is different, replace the motor.
- Try replacing the main control board to see if it can solve the problem.
- Replace the motor.

9.4.9 Outdoor coil temperature over-high protection (cooling mode) $T3 > 60^{\circ}\text{C}$

Cause: The condenser temperature sensor detected that the temperature was too high

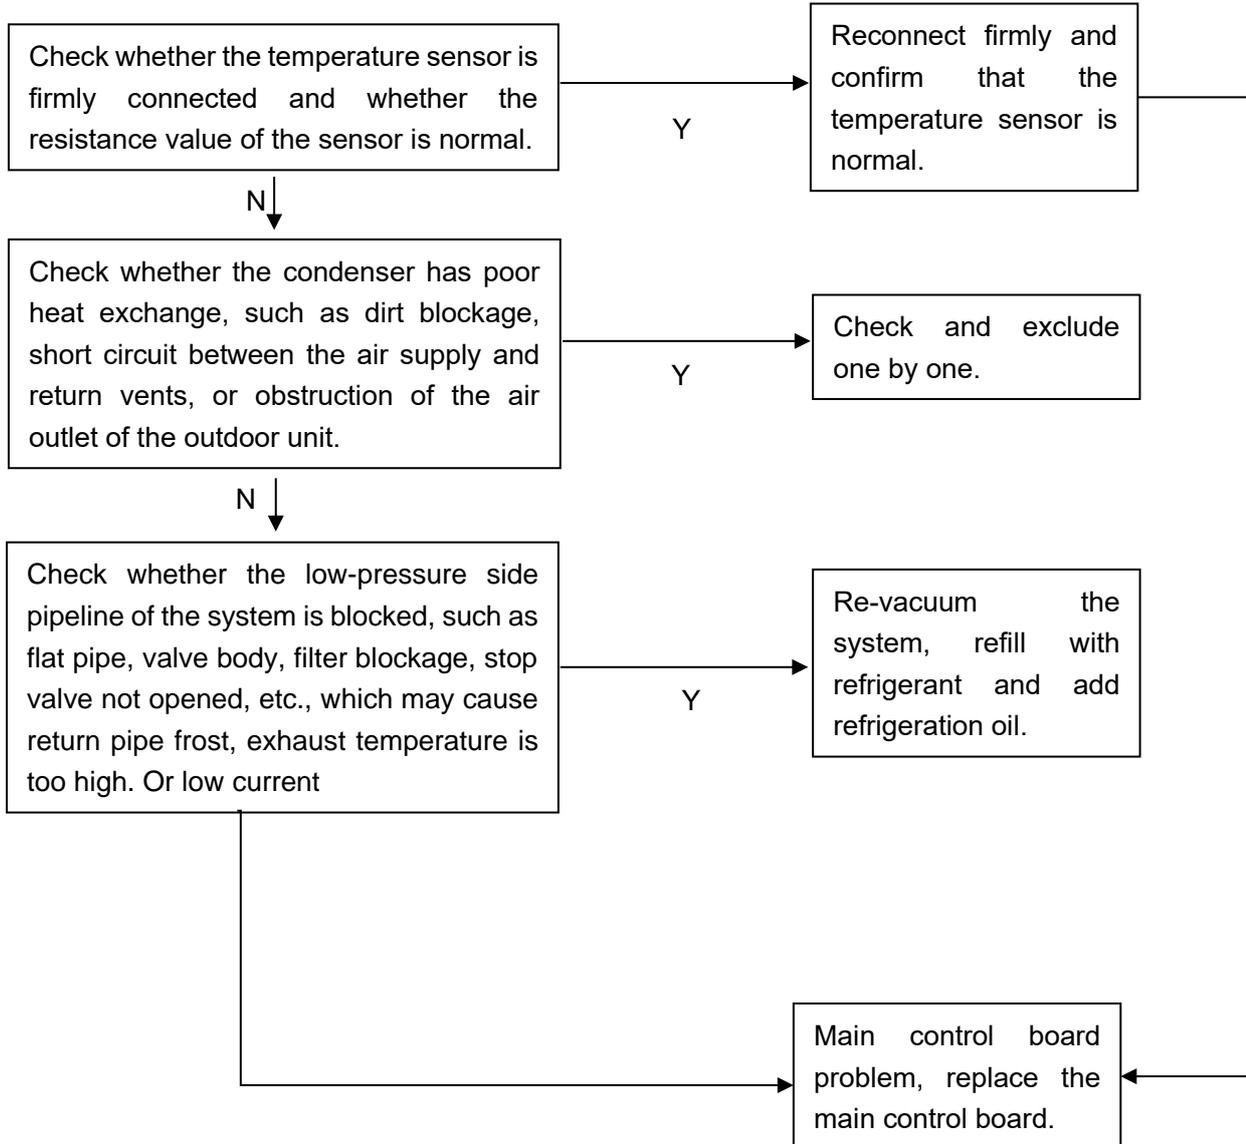

- Check if the heat dissipation of the condenser is normal, ensuring that there are no dirty blockages, short circuits in the air supply and return ports, etc.
- Measure the resistance of the temperature sensor and check whether it drifts by comparing it with the resistance table. If it drifts, replace the sensor. Please see the appendix for R-T table

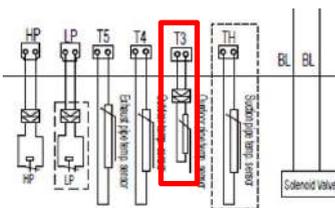


- If the temperature sensor resistance is normal, check the exhaust temperature in item 8 and compare it with the actual exhaust temperature (use a infrared thermometer to

measure the exhaust temperature). If the temperature of the main control board is unreasonable, replace the main control board.

- If the above steps are normal, check whether the refrigerant system is normal, such as return air blockage, poor evaporation, compressor wear, etc.

9.4.10 Exhaust temperature too high protection >120°C


Cause: The exhaust temperature sensor reads a temperature that is too high

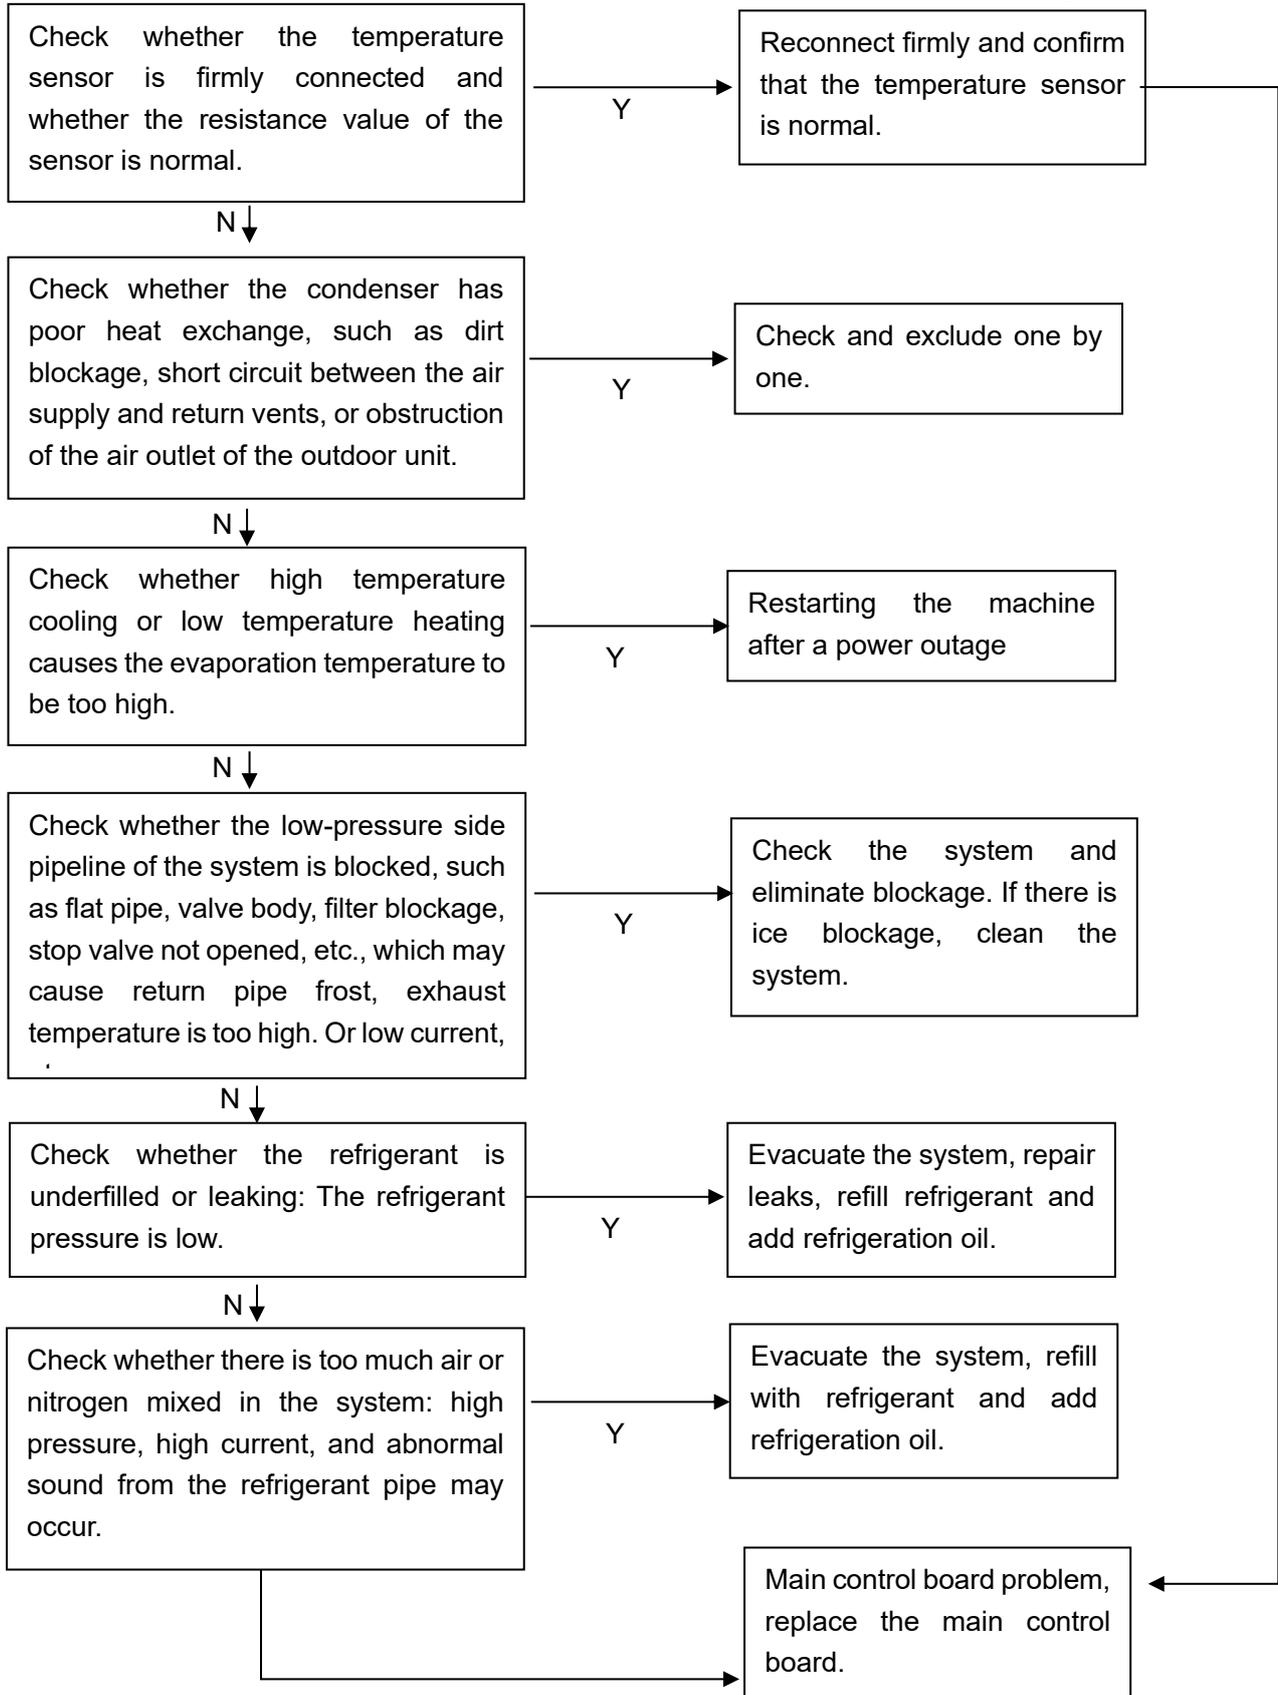

➤ Connect a pressure gauge to measure whether the return gas pressure is too low


(normally 0.7-0.9MPa). If the pressure is too low, add refrigerant.

- Measure the resistance of the temperature sensor and check whether it drifts by comparing it with the resistance table. If it drifts, replace the sensor. Please see the appendix for R-T table
- If the above steps are normal, check whether the refrigerant system is normal, such as return air blockage, poor evaporation, compressor wear, etc.

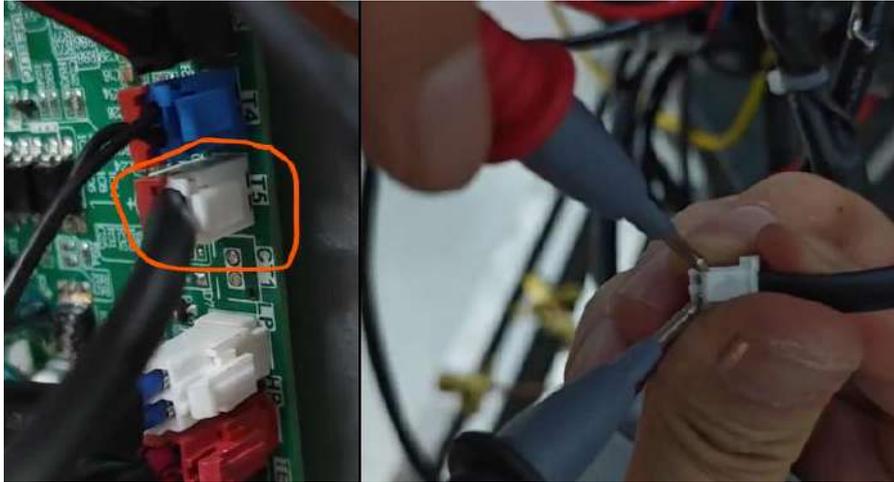

9.4.11 Overtemperature protection

Cause: Outdoor sensor T4 detects that the ambient temperature exceeds the range

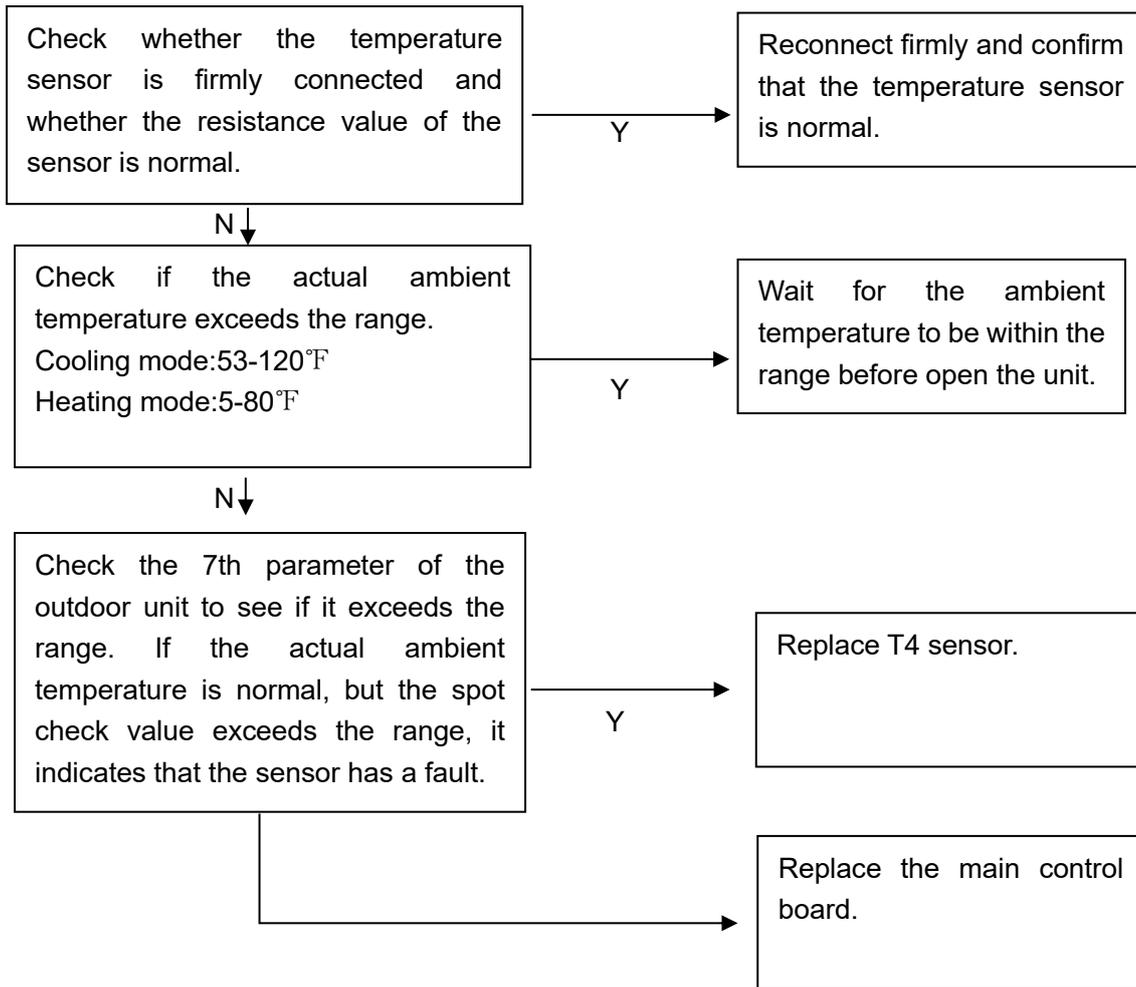

Part 4 Function introduction

1.Electrical Components Description	54
2.Indoor Coil Anti-Freezing Function.....	54
3.Outdoor gas return temperature Anti-Freezing Function	55
4.R454B Leakage Detection Function	55
5.Defrost Description	55

1. Electrical Components Description

Temperature Sensor

T1: IDU Ambient Temperature

- capacity demand control (R485 mode)
- Defrost control (heating mode)

T2: Indoor Coil Temperature

- Anti-Freezing Function

T3: Outdoor Coil Temperature

- High/Low temperature protection
- Outdoor fan control (cooling mode)
- Defrost control (heating mode)

T4: ODU Ambient Temperature

- Operating condition permission
- Defrosting condition (heating mode)
- Outdoor fan control (heating mode)

T5: Compressor Discharge Temperature

- High temperature / Low superheat protection
- Electronic Expansion Valve (EEV) control

Reversing valve operation

- Reversing valve energizes during heat mode and de-energizes in cool

Compressor Crankcase Heater Description

— Refrigerant migration during the OFF cycle can result in noisy start-ups, therefore a Crankcase Heater (CCH) is used to minimize refrigerant migration thereby minimizing start-up noise and/or bearing “wash out”. All CCHs must be installed around the lower half of the compressor shell. Its purpose is to warm the compressor during the OFF cycle, driving refrigerant from compressor. After extended shutdown periods in cold weather, it is recommended to allow CCH to be energized for at least 12 hours prior to compressor operation by applying line voltage to heat pump with thermostat OFF. CCH operation energizes:

2. Indoor Coil Anti-Freezing Function

The function utilizes the indoor coil sensor(T2) to determine whether the indoor coil is freezing or not. The feature prevents the unit running at low evaporating temperature as well as low suction superheat.

When all the following conditions are met, the Anti-Freezing Function will activate, and the compressor will be turned off.

A. $T2 < 32^{\circ}\text{F}$ Duration exceeding 1 minute.

B. $T2 \leq 26.6^{\circ}\text{F}$ Duration exceeding 30 seconds.

when $T2 \geq 42.8^{\circ}\text{F}$, the Anti-Freezing Function will deactivate:

3.Outdoor gas return temperature Anti-Freezing Function

The function utilizes the Outdoor gas return temperature (TH) to determine whether the indoor coil is freezing or not. The feature prevents the unit running at low evaporating temperature as well as low suction superheat.

Only valid in cooling mode and after the compressor has been running for 3 minutes.

When the gas return temperature $TH \leq TH1$ for “t” minutes, or the gas return temperature $TH \leq TH2$, the compressor and the outdoor fan will be stopped, and the anti-freezing protection will be reported

	TH1	TH2	t
$T4 \leq 8^{\circ}\text{C}$	-1	-4	0
$8^{\circ}\text{C} < T4 \leq 16^{\circ}\text{C}$	-1	-4	$20 + 5 * (T4 - 12)$
$16^{\circ}\text{C} < T4 \leq 35^{\circ}\text{C}$	$-1 + 0.15 * (T4 - 16)$	$-4 + 0.3 * (T4 - 16)$	40
$T4 > 35^{\circ}\text{C}$	$2 + 0.2 * (T4 - 35)$	$2 + 0.1 * (T4 - 35)$	40

When the return air temperature is greater than 10 degrees or the shutdown time reaches 6 minutes, start the compressor and external fan (the minimum start interval is 5 minutes).

4.R454B Leakage Detection Function

The function utilizes a R454B refrigerant sensor to detect the R454B concentration. Terminal F/L2 is reserved for connecting buzzer if needed.

When R454B leakage occur in the indoor coil and the concentration is above 10%LEF, the unit will perform as the following:

- A. Cut off power to thermostat to stop compressor operation.
- B. Electric Heat kit will be turned off.
- C. High voltage will be output between terminal F and terminal L2.
- D. The indoor fan is running at high wind speed, and at the same time, the fault light on the indoor mainboard is flash.

5.Defrost Description

According to the actual situation on site, the machine has multiple defrost modes to choose from:

Auto defrost:

the machine measures the ambient temperature and the temperature of the outdoor coil through sensors and calculates the condensation pressure and machine running time to determine whether to enter defrost mode. When the temperature of the coil exceeds the set value, the machine automatically exits defrosting mode.

Manual defrost mode:

Through SW2-1, it can manually force the machine to enter defrost mode.

Fixed time defrosting:

You can choose to activate the defrost function every 30 minutes or 60 minutes. When the temperature of the coil exceeds the set value, the machine automatically exits defrosting mode.

Defrosting choice	SW2-1	SW2-2	SW2-3	SW2-4
ON	Manual defrost mode	Fix timed defrost	Timer 30 min	Reserve
OFF	Auto Defrost (factory default)	Auto Defrost (factory default)	Timer 60 min (factory default)	Reserve
Remark	Defrosting: control mode selection	Cycle time selection	Only applicable to fix timed defrosting timer and the Minimum Runtime Timer	Do not to adjust this dial

If SW2-2 is ON, the fixed defrost time is determined by SW2-3 dial selection

Part 5 Installation

1.Precauton on Installation.....	58
2.Oil return bend installation	60
3.Vacuum Dry and Leakage Checking	61
4.Additional Refrigerant Charge.....	63
5.Insulation Work	65
6.Test Operation.....	67

1. Precaution on Installation

1.1. Measure pipe length

Measure the necessary length of the connecting pipe and make it by the following way. Connect the indoor unit at first, then the outdoor unit.

Bend the tubing in proper way.

Please refer to the table below for the length dimensions of the connection pipe

Table 1.1.1 In general mode

Refrigerant Piping		Capacity (Btu/h)						
		18K	24K	30K	36K	42K	48K	60K
Liquid-Vapor	In.	3/8-3/4	3/8-3/4	3/8-3/4	3/8-3/4	3/8-7/8	3/8-7/8	3/8-7/8
Max. Refrigerant Line Length*	Ft.	100						
Max. Vertical Lift	Ft.	26						

Table 1.1.2 In high vertical mode

Refrigerant Piping		Capacity (Btu/h)							
		18K	24K	30K	36K	42K	48K	60K	
Liquid-Vapor	In.	3/8-3/4	3/8-3/4	3/8-3/4	3/8-3/4	3/8-7/8	3/8-7/8	3/8-7/8	
Max. Refrigerant Line Length*	Ft.	131					147		
Max. Vertical Lift	Ft.	60					60		

Table 1.1.3 Dip Switch Diagram

Dial switch	ON	OFF
SW1-4	High-vertical mode	General mode



CAUTIONS:

Daub the surfaces of the flare pipe and the joint nuts with frozen oil, and wrench it for 3~4 rounds

With hands before fasten the flare nuts.

Be sure to use two wrenches simultaneously when you connect or disconnect the pipes.

Pipe gauge	Tightening torque	Flare dimension A		Flare shape
		Min (mm)	Max	
Φ6.35	15~16N.m (153~163 kgf.cm)	8.3	8.7	
Φ9.52	25~26N.m (255~265kgf.cm)	12.0	12.4	
Φ12.7	35~36N.m	15.4	15.8	

15SEER REGULAR SPLITS SYSTEM TECHNICAL MANUAL

	(357~367kgf.cm)			
Φ15.9	45~47N.m (459~480 kgf.cm)	18.6	19.1	
Φ19.1	65~67N.m (663~684kgf.cm)	22.9	23.3	

The stop value of the outdoor unit should be closed absolutely (as original state). Every time you connect it, first loosen the nuts at the part of stop value, then connect the flare pipe immediately (in 5 minutes). If the nuts have been loosened for a long time, dusts and other impurities may enter the pipe system and may cause malfunction later. So please expel the air out of the pipe with refrigerant before connection.

Expel the air after connecting the refrigerant pipe with the indoor unit and the outdoor unit. Then fasten the nuts at the repair-points.

1.2. Locate The Pipe

Drill a hole in the wall (suitable just for the size of the wall conduit), then set on the fittings such as the wall conduit and its cover.

Bind the connecting pipe and the cables together tightly with binding tapes. Do not let air in, which will cause water leakage by condensation.

Pass the bound connecting pipe through the wall conduit from outside. Be careful of the pipe allocation to do no damage to the tubing.

1.3. Connect the pipes.

1.4. Then, open the stem of stop values of the outdoor unit to make the refrigerant pipe connecting the indoor unit with the outdoor unit in fluent flow.

1.5. Be sure of no leakage by checking it with leak detector or soap water.

1.6. Cover the joint of the connecting pipe to the indoor unit with the soundproof / insulating sheath (fittings), and bind it well with the tapes to prevent leakage.


2. Oil return bend installation

Note that the length of the connecting line from the outdoor unit to the indoor unit cannot exceed 100 feet.

- If all long lines are in a horizontal state, no additional measures are required;
- If there is a vertical height difference in the long line, it needs to be installed according to the following requirements:
 - When the vertical height difference is $0 < h \leq 16.5$ feet, no additional measures are required;
 - When the vertical height difference is $16.5 \text{ feet} < h \leq 33$ feet, an oil return bend needs to be added in the middle of the height difference.
 - When the vertical height difference is $33 \text{ feet} < h \leq 50$ feet, two oil return bends need to be added at an equal distance in the height difference.


NOTE: The vertical height difference between the outdoor unit and the indoor unit cannot exceed 50 feet.

The following is the connection method of the oil return bend.

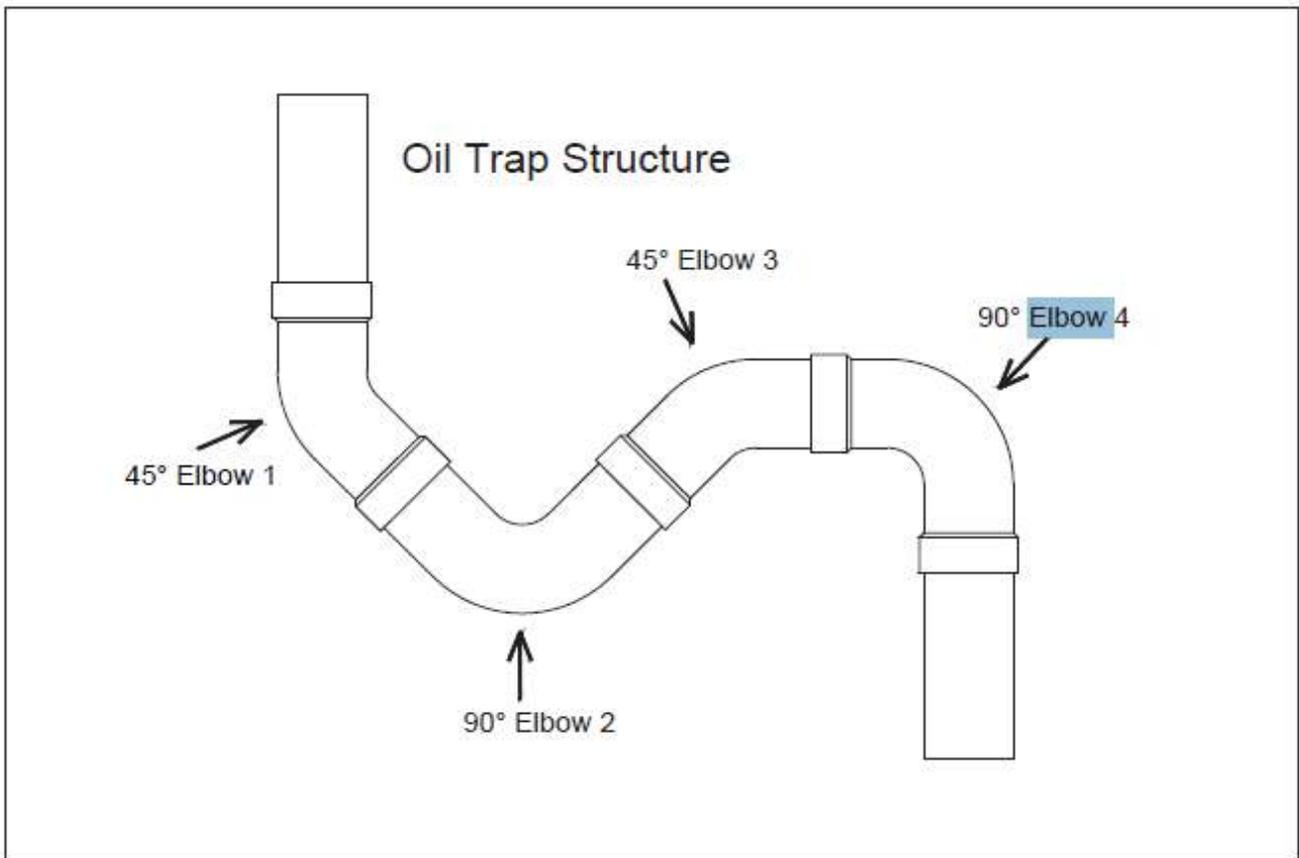

3. Vacuum Dry and Leakage Checking

3.1 Vacuum Dry: use vacuum pump to change the moisture (liquid) into steam (gas) in the pipe and discharge it out of the pipe to make the pipe dry. Under one atmospheric pressure, the boiling point of water (steam temperature) is 100°C. Use vacuum pump to make the pressure in the pipe near vacuum state, the boiling point of water falls relatively. When it falls under outdoor temperature, the moisture in the pipe will be vaporized.

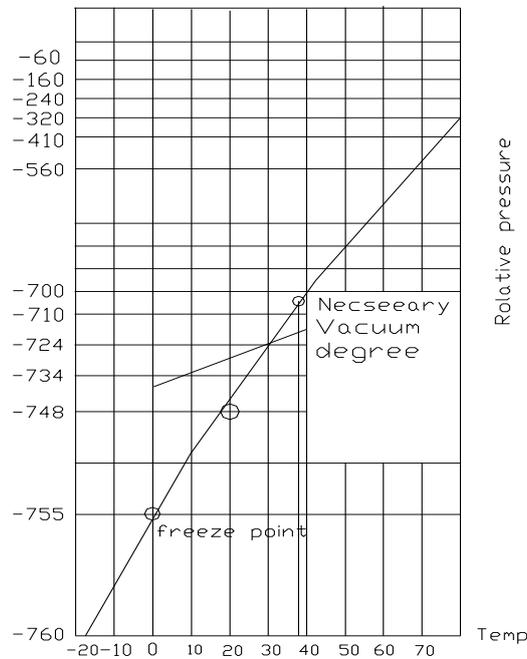

3.2 Vacuum dry procedure

There are two methods of vacuum dry due to different construction environment: common vacuum dry, special vacuum dry.

①. Common vacuum dry procedure

Vacuum dry (for the first time) ---connect the all-purpose detector to the inlet of liquid pipe and gas pipe, and run the vacuum pump more than two hours (the vacuum pump should be below -755mmHg)


If the pump can't achieve below -755mmHg after pumping 2 hours, moisture or leakage point will still exist in the pipe. At this time, it should be pumped 1 hour more.

If the pump can't achieve -755mmHg after pumping 3 hours, please check if there are some leakage points.

Vacuum placement test: place 1 hour when it achieves -755mmHg, pass if the vacuum watch shows no rising. If it rises, it shows there's moisture or leakage point.

Vacuumping from liquid pipe and gas pipe at the same time.

Sketch map of common vacuum dry procedure.

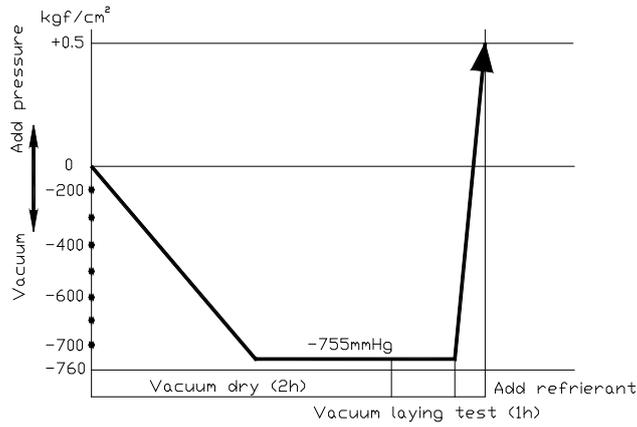


② Special vacuum dry procedure

- a. Vacuum dry for the first time 2h pumping
- b. Fill nitrogen to 0.5Kgf/cm²

Because nitrogen is for drying gas, it has vacuum drying effect during vacuum destroy. But if the moisture is too much, this method can't dry thoroughly. So, please pay more attention to prevent water entering and forming condensation water.

- c. Vacuum dry for the second time for 1h pumping
- If -755mmHg can't be achieved in 2h, repeat procedure "b" and "c".
- d. Vacuum placing test 1h
- e. Sketch map of special vacuum dry procedure

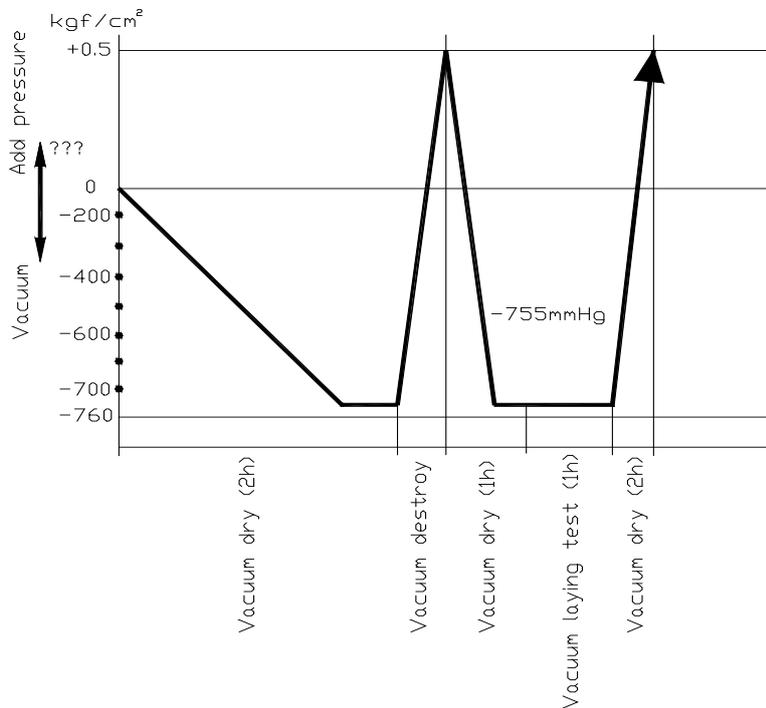

4. Additional Refrigerant Charge

Caution

- Refrigerant cannot be charged until field wiring has been completed.
- Refrigerant may only be charged after performing the leak test and the vacuum pumping.
- When charging a system, care shall be taken that its maximum permissible charge is never exceeded, in view of the danger of liquid hammer.
- Charging with an unsuitable substance may cause explosions and accidents, so always ensure that the appropriate refrigerant is charged.
- Refrigerant containers shall be opened slowly.
- Always use protective gloves and protect your eyes when charging refrigerant.

Weigh-In Method

The factory charge in the outdoor unit is sufficient for 25 feet of standard size interconnecting liquid line. Additional 0.54 oz/ft refrigerant is needed when length of pipe is more than 25 feet.

Additional Refrigerant Guidelines

Piping length (ft)/(m)	Additional charge (oz)/(kg)
25 / (7.62)	0
75 / (22.86)	27.00/(0.76)
100 / (30.48)	40.50/(1.14)
131 / (39.93)	56.7/(1.62)
147 / (44.81)	65.88/(1.86)

Subcooling Method (10°F ± 2°F)

Check the ambient temperature. Subcooling method (cooling mode) is only for outdoor temperature between 68°F and 113°F, and indoor temperature between 68°F and 89°F. For temperature out of the range, use the weighing method mentioned above.

1. Start "forced cooling" mode.

Press the "Check" (K4) button for about 5 seconds to enter Force cooling mode. The LED display will show "dC".

2. Wait until the system is basically stable.

Wait for twenty (20) minutes after "forced cooling" mode started. Compressor will maintain a specific frequency in "forced cooling" mode.

3. Calculate subcooling value.

Calculate subcooling value with measured liquid line temperature and pressure. If calculated subcooling value is lower than the design subcooling value of 10°F ± 2°F, refrigerant should be added. If calculated subcooling value is higher than the value shown in table "R-454B Refrigerant Physical Property", refrigerant should be recovered.

4. Adjust refrigerant.

Connect service tools to unit and adjust refrigerant according to analysis in step 4.

5. Wait for stabilization of system.

Wait for 5 minutes, and repeat steps 4 through 5 until subcooling value matches the design subcooling value mentioned in step 4.

6. Recover normal mode.

15SEER REGULAR SPLITS SYSTEM TECHNICAL MANUAL

Remove service tools and short press "Check" (K4) " button to quit "forced cooling" mode. Symbol "dC" should disappear when "forced cooling" mode quitted.

Liquid Line Temp (°F)	Subcooling Value(°F)							
	6	7	8	9	10	11	12	13
	Liquid Gauge Pressure (PSI)							
55	164	167	170	172	175	178	181	184
60	178	181	184	187	191	194	197	200
65	194	197	200	203	206	210	213	217
70	210	213	217	220	223	227	230	234
75	227	230	234	238	241	245	249	252
80	245	249	252	256	260	264	268	272
85	264	268	272	276	280	284	288	292
90	284	288	292	297	301	305	309	314
95	305	309	314	318	323	327	332	336
100	327	332	336	341	346	351	355	360
105	351	355	360	365	370	375	380	385
110	375	380	385	390	396	401	406	412
115	401	406	412	417	422	428	433	439
120	428	433	439	445	450	456	462	468
125	456	462	468	474	480	486	492	498

Subcooling (°F)		Ambient Remperature (°F)				
		68~77	77~86	86~95	95~104	104~113
Model	24K	10±2	8±2	8±2	6±2	6±2
	36K	10±2	8±2	8±2	6±2	6±2
	48K	8±2	8±2	8±2	6±2	6±2
	60K	8±2	8±2	8±2	6±2	6±2

5. Insulation Work

5.1 Insulation material and thickness

5.1.1. Insulation material

Insulation material should adopt the material which is able to endure the pipe's temperature: no less than 70°C in the high-pressure side, no less than 120°C in the low-pressure side (For the cooling type machine, no requirements at the low-pressure side.)

Example: Heat pump type----Heat-resistant Polyethylene foam (withstand above 120°C)

Cooling only type----Polyethylene foam (withstand above 100°C)

5.1.2. Thickness choice for insulation material

Insulation material thickness is as follows:

	Pipe diameter (mm)	Adiabatic material thickness
Refrigerant pipe	Φ6.4—Φ25.4	10mm
	Φ28.6—Φ38.1	15mm
Drainage pipe	Inner diameter Φ20—Φ32	6mm

5.2 Refrigerant pipe insulation

5.2.1. Work Procedure

① Before laying the pipes, the non-jointing parts and non-connection parts should be heat insulated.

② When the gas proof test is eligible, the jointing area, expanding area and the flange area should be heat insulated.

5.2.2. Insulation for non-jointing parts and non-connection parts


wrong	right	
Gas pipe and liquid pipe should not be put together to insulate	Insulate the gas pipe (cooling only)	Insulate the gas pipe and liquid pipe

15SEER REGULAR SPLITS SYSTEM TECHNICAL MANUAL

For construction convenience, before laying pipes, use insulation material to insulate the pipes to be deal with, at the same time, at two ends of the pipe, remain some length not to be insulated, in order to be welded and check the leakage after laying the pipes.

5.2.3. Insulate for the jointing area, expanding area and the flange area

- ① Insulate for the jointing area, expanding area and the flange area should be done after checking leakage of the pipes
- ② Make sure there's no clearance in the joining part of the accessorial insulation material and local preparative insulation material.

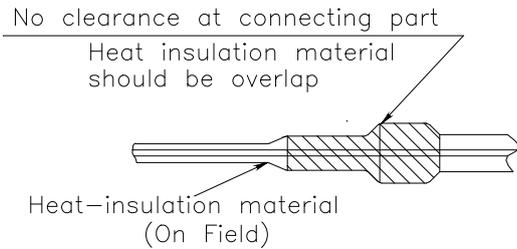

5.3 Drainage pipe insulation

The connection part should be insulated, or else water will be condensing at the non-insulation part.

5.4 Note

5.4.1 The jointing area, expanding area and the flange area should be heat insulated after passing the pressure test.

5.4.2 The gas and liquid pipe should be heat insulated individually, the connecting part should be heat insulated individually.

5.4.3 Use the attached heat-insulation material to insulate the pipe connections (pipes' tie-in, expand nut) of the indoor unit.

6. Test Operation

(1) The test operation must be carried out after the entire installation has been completed.

(2) Please confirm the following points before the test operation.

The indoor unit and outdoor unit are installed properly.

Tubing and wiring are correctly completed.

The refrigerant pipe system is leakage-checked.

The drainage is unimpeded.

The ground wiring is connected correctly.

The length of the tubing and the added stow capacity of the refrigerant have been recorded.

The power voltage fits the rated voltage of the air conditioner.

There is no obstacle at the outlet and inlet of the outdoor and indoor units.

The gas-side and liquid-side stop valves are both opened.

The air conditioner is pre-heated by turning on the power.

(3) According to the user's requirement, install the 24v thermostat

(4) Test operation

Set the air conditioner under the mode of "COOLING" with the thermostat.

, and check the following points.

Indoor unit

Whether the fan motor operate normally.

Whether the room temperature is adjusted well.

Whether the indicator lights of indoor board normally.

Whether the drainage is normal.

Whether there is vibration or abnormal noise during operation.

Outdoor unit

Whether there is vibration or abnormal noise during operation.

Whether the generated wind, noise, or condensed of by the air conditioner have influenced your neighborhood.

Whether any of the refrigerant is leaked.

Appendix: R-T table

5K: Applicable T1/T2/T3/T4 temperature sensor

T (°C)	Rmin (KΩ)	Rnom (KΩ)	Rmax (KΩ)	T (°C)	Rmin (KΩ)	Rnom (KΩ)	Rmax (KΩ)
-30	51.159	52.84	54.521	26	4.771	4.821	4.871
-29	48.659	50.232	51.805	27	4.599	4.649	4.699
-28	46.299	47.772	49.248	28	4.434	4.485	4.535
-27	44.071	45.452	46.832	29	4.277	4.327	4.377
-26	41.968	43.261	44.554	30	4.126	4.176	4.226
-25	39.981	41.193	42.405	31	3.981	4.031	4.081
-24	38.102	39.238	40.375	32	3.842	3.892	3.942
-23	36.326	37.391	38.457	33	3.709	3.759	3.808
-22	34.646	35.645	36.645	34	3.581	3.631	3.68
-21	33.055	33.993	34.931	35	3.495	3.508	3.557
-20	31.55	32.43	33.31	36	3.34	3.389	3.438
-19	30.097	30.923	31.748	37	3.226	3.275	3.323
-18	28.722	29.497	30.271	38	3.117	3.165	3.213
-17	27.42	28.147	28.873	39	3.012	3.06	3.107
-16	26.186	26.868	27.55	40	2.912	2.959	3.006
-15	25.017	25.657	26.297	41	2.815	2.861	2.908
-14	23.908	24.509	25.11	42	2.722	2.768	2.814
-13	22.857	23.421	23.985	43	2.633	2.678	2.724
-12	21.859	22.389	22.918	44	2.547	2.592	2.637
-11	20.912	21.409	21.907	45	2.464	2.509	2.553
-10	20.013	20.48	20.917	46	2.385	2.429	2.473
-9	19.116	19.584	20.023	47	2.308	2.352	2.395
-8	18.322	18.734	19.146	48	2.235	2.278	2.231
-7	17.54	17.927	18.314	49	2.164	2.207	2.249
-6	16.797	17.16	17.524	50	2.096	2.138	2.18
-5	16.09	16.431	16.733	51	2.03	2.071	2.112
-4	15.418	15.739	16.06	52	1.966	2.006	2.047
-3	14.779	15.08	15.382	53	1.904	1.944	1.984
-2	14.17	14.454	14.737	54	1.844	1.884	1.923
-1	13.591	13.857	14.124	55	1.787	1.826	1.865
0	13.04	13.29	13.54	56	1.732	1.77	1.809
1	12.505	12.739	12.974	57	1.679	1.717	1.754
2	11.995	12.215	12.436	58	1.628	1.665	1.702
3	11.509	11.717	11.924	59	1.579	1.615	1.652
4	11.047	11.241	11.436	60	1.531	1.567	1.603
5	10.606	10.789	10.971	61	1.485	1.521	1.556
6	10.186	10.357	10.529	62	1.441	1.476	1.511
7	9.785	9.945	10.107	63	1.399	1.433	1.467
8	9.403	9.554	9.705	64	1.357	1.391	1.425
9	9.038	9.18	9.322	65	1.318	1.351	1.384
10	8.69	8.823	8.956	66	1.279	1.312	1.344
11	8.357	8.482	8.607	67	1.242	1.274	1.306
12	8.04	8.157	8.274	68	1.206	1.237	1.269
13	7.736	7.816	7.957	69	1.171	1.202	1.233
14	7.446	7.55	7.653	70	1.137	1.168	1.199
15	7.169	7.266	7.363	71	1.105	1.135	1.165
16	6.9	6.991	7.082	72	1.074	1.103	1.133
17	6.644	6.729	6.814	73	1.043	1.072	1.101
18	6.398	6.478	6.558	74	1.014	1.043	1.071
19	6.163	6.238	6.313	75	0.986	1.014	1.042
20	5.938	6.008	6.078	76	0.959	0.986	1.014
21	5.723	5.789	5.854	77	0.932	0.959	0.986
22	5.517	5.578	5.64	78	0.907	0.933	0.96
23	5.32	5.377	5.484	79	0.882	0.908	0.934
24	5.131	5.185	5.238	80	0.858	0.884	0.91
25	4.95	5	5.05				

50K: Applicable exhaust temperature sensor (T5/TP)

T (°C)	Rmin (KΩ)	Rnom (KΩ)	Rmax (KΩ)	T (°C)	Rmin (KΩ)	Rnom (KΩ)	Rmax (KΩ)
0	157.7	161.2	164.7	56	14.16	14.48	14.81
1	150.2	153.4	156.7	57	13.65	13.96	14.28
2	142.9	145.9	148.9	58	13.15	13.46	13.77
3	136.1	138.9	141.7	59	12.69	12.99	13.30
4	129.7	132.3	134.9	60	12.23	12.53	12.83
5	123.6	126.0	128.4	61	11.80	12.09	12.39
6	117.8	120.0	122.3	62	11.39	11.67	11.96
7	112.2	114.3	116.4	63	10.98	11.26	11.54
8	107.1	109.0	111.0	64	10.60	10.87	11.15
9	102.1	103.9	105.7	65	10.23	10.50	10.77
10	97.42	99.08	100.8	66	9.880	10.14	10.41
11	92.97	94.51	96.06	67	9.537	9.792	10.05
12	88.74	90.17	91.61	68	9.211	9.460	9.715
13	84.73	86.05	87.38	69	8.897	9.141	9.391
14	80.92	82.14	83.37	70	8.595	8.834	9.078
15	77.29	78.42	79.56	71	8.306	8.539	8.778
16	73.84	74.89	75.95	72	8.028	8.256	8.490
17	70.57	71.54	72.51	73	7.759	7.983	8.212
18	67.46	68.35	69.25	74	7.501	7.720	7.944
19	64.49	65.32	66.15	75	7.254	7.468	7.687
20	61.68	62.44	63.20	76	7.016	7.225	7.440
21	59.00	59.70	60.40	77	6.786	6.991	7.201
22	56.44	57.09	57.74	78	6.565	6.765	6.971
23	54.02	54.61	55.20	79	6.352	6.548	6.749
24	51.70	52.25	52.80	80	6.147	6.339	6.536
25	49.50	50.00	50.50	81	5.950	6.138	6.331
26	47.37	47.87	48.37	82	5.761	5.944	6.133
27	45.34	45.84	46.34	83	5.578	5.757	5.942
28	43.41	43.91	44.41	84	5.401	5.577	5.758
29	41.59	42.08	42.57	85	5.231	5.403	5.580
30	39.84	40.33	40.82	86	5.069	5.237	5.410
31	38.18	38.66	39.15	87	4.912	5.076	5.245
32	36.59	37.07	37.55	88	4.760	4.921	5.087
33	35.07	35.55	36.03	89	4.615	4.772	4.934
34	33.64	34.11	34.58	90	4.474	4.628	4.787
35	32.27	32.73	33.20	91	4.338	4.489	4.645
36	30.95	31.41	31.87	92	4.207	4.354	4.506
37	29.70	30.15	30.61	93	4.081	4.225	4.374
38	28.50	28.95	29.40	94	3.958	4.099	4.245
39	27.37	27.81	28.25	95	3.840	3.978	4.121
40	26.29	26.72	27.16	96	3.726	3.861	4.001
41	25.24	25.67	26.10	97	3.616	3.748	3.885
42	24.25	24.67	25.09	98	3.509	3.639	3.773
43	23.31	23.72	24.14	99	3.407	3.534	3.665
44	22.41	22.81	23.22	100	3.308	3.432	3.560
45	21.53	21.93	22.33	101	3.212	3.333	3.459
46	20.71	21.10	21.50	102	3.119	3.238	3.361
47	19.92	20.30	20.69	103	3.030	3.146	3.267
48	19.16	19.54	19.92	104	2.942	3.056	3.174
49	18.44	18.81	19.18	105	2.858	2.970	3.086
50	17.75	18.11	18.48	106	2.778	2.887	3.000
51	17.08	17.44	17.80	107	2.699	2.806	2.917
52	16.44	16.79	17.14	108	2.623	2.728	2.837
53	15.84	16.18	16.53	109	2.549	2.652	2.758
54	15.26	15.59	15.93	110	2.479	2.579	2.683
55	14.69	15.02	15.35				



**Thank you for purchasing
CoolPro air conditioning**